

NEW

ACOUSTICAL GUIDE

ACOUSTIC RESEARCH REPORT ON
MASS TIMBER BUILDINGS BY

AcoustiTECH
PERFORMANCE CREDIBILITY EXPERTISE



Final report

R&D Project

Date: March 15th, 2018



PREPARED BY

A handwritten signature in black ink, appearing to read "D. Dompierre", written over a horizontal line.

David Dompierre
Project Director
Senior Research Specialist

A handwritten signature in black ink, appearing to read "S. Garant", written over a horizontal line.

Samuel Garant
Project Manager
Research Specialist

A division of **Finitec Group**

150 Leon-Vachon
St. Lambert-de-Lauzon, Quebec
Canada, G0S 2W0

T. 1-888-838-4449
F. 1-418-889-9915
service@acousti-tech.com

acousti-tech.com

TABLE OF CONTENTS

INTRODUCTION & REFERENCES	P.4
BARE CLT – IIC 23.....	P.6
COMMON ASSEMBLIES WITH CONCRETE TOPPING	
SOPREMA INSONOMAT - IIC 44.....	P.8
SOPREMA INSONOMAT + INSONOFLOOR - IIC 49.....	P.10
REGUPOL SONUSWAVE - IIC 47.....	P.12
REGUPOL SONUSWAVE + INSONOFLOOR - IIC 53.....	P.14
LIGHTWEIGHT DRY FLOORING ELEMENTS / CEMENT BOARDS	
FERMACELL 2E32 - IIC 43.....	P.16
FERMACELL 2E32 + 12.5 + INSONOFLOOR - IIC 44.....	P.18
FERMACELL HONEYCOMB + 2E32 + INSONOFLOOR - IIC 49.....	P.20
FERMACELL HONEYCOMB + 2E32 + 12.5 + INSONOFLOOR - IIC 50.....	P.22
SONO/MAX 25 + INSONOFLOOR - IIC 45.....	P.24
LIGHTWEIGHT	
ACOUSTITECH SOFIX + INSONOFLOOR – IIC 51.....	P.26
ACOUSTITECH SOFIX + CERAMIC - IIC 54.....	P.28
ACOUSTITECH LEAD 6 + SOFIX + CERAMIC - IIC 58.....	P.30
COMPLEX ASSEMBLIES	
CONCRETE + ACOUSTITECH LEAD 6 + SOFIX + INSONOFLOOR - IIC 58.....	P.32
CONCRETE + ACOUSTITECH SOFIX + CERAMIC - IIC 60.....	P.34
CONCRETE + ACOUSTITECH LEAD 6 + SOFIX + CERAMIC - IIC 63.....	P.36
SOPREMA INSONOMAT + CONCRETE + ACOUSTITECH SOFIX + INSONOFLOOR - IIC 57.....	P.38
SOPREMA INSONOMAT + CONCRETE + ACOUSTITECH SOFIX + CERAMIC - IIC 59.....	P.40
WOOD RAFTS + FIBERGLASS + SOPREMA INSONOMAT - IIC 56.....	P.42
WOOD RAFTS + FIBERGLASS + SOPREMA INSONOMAT + INSONOFLOOR - IIC 61	P.44
WOOD RAFTS + FIBERGLASS + REGUPOL SONUSWAVE - IIC 57.....	P.46
WOOD RAFTS + FIBERGLASS + REGUPOL SONUSWAVE + INSONOFLOOR - IIC 63	P.48
WOOD RAFTS + SAND + SOPREMA INSONOMAT - IIC 57.....	P.50
WOOD RAFTS + SAND + SOPREMA INSONOMAT + INSONOFLOOR - IIC 61.....	P.52
WOOD RAFTS + SAND + REGUPOL SONUSWAVE - IIC 58.....	P.54
WOOD RAFTS + SAND + REGUPOL SONUSWAVE + INSONOFLOOR - IIC 64.....	P.56

INTRODUCTION

AcoustiTECH is a North American leader in acoustic solutions and has quickly become the reference standard in the industry. For 25 years, AcoustiTECH has teamed up with architects, builders, general contractors, acoustic consultants and other stakeholders to help them achieve their vision by providing proven acoustical solutions and expertise. AcoustiTECH looks at the specific requirements of each individual project, evaluates the requirements, determines the needs and provides personalized solutions. AcoustiTECH's approach is unique, efficient and reliable.

We possess our own acoustic laboratory that we use for our research and development in order to recommend the best acoustic solutions by type of structure. Thousands of tests have been performed including over 300 on heavy timber assemblies.

The principal objective of creating this document is for the professionals to compare and choose from 25 assemblies the ones that suit their needs the best. The most interesting and popular assemblies have been selected and compared side by side in the same environment, built and tested by the same professional using the same flooring materials.

It is important to note that the quality of construction can affect the performance. Indeed, construction standards and assemblies recommendations must be followed in order to reach the seeking performance.

REFERENCE BY TERRITORY

OFFICE / TECHNICAL SERVICE

Cathy Gagné, Sales & Development Coordinator
1-888-838-4449 ext. 235 / cathy@acousti-tech.com

David Dompierre, Senior research specialist
david@acousti-tech.com

Samuel Garant, Research specialist
samuel@acousti-tech.com

QUEBEC

Vincent Moreau, VP AcoustiTECH
418-951-3225 / vmoreau@acousti-tech.com

ONTARIO

Cristian Wallace, Business Development and Specifications
416-518-8044 / cwallace@acousti-tech.com

WESTERN CANADA / USA

André Rioux, VP Sales & Development
403-462-6060 / arioux@acousti-tech.com

TEST REPORTS

BARE CLT

IIC 23



Project : Mass timber comparative study

Test : Test 1 - Bare CLT

Description :


Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2

Results :

IIC	23,1
Defavorable deviations	31,8

Assembly description


CLT 131mm

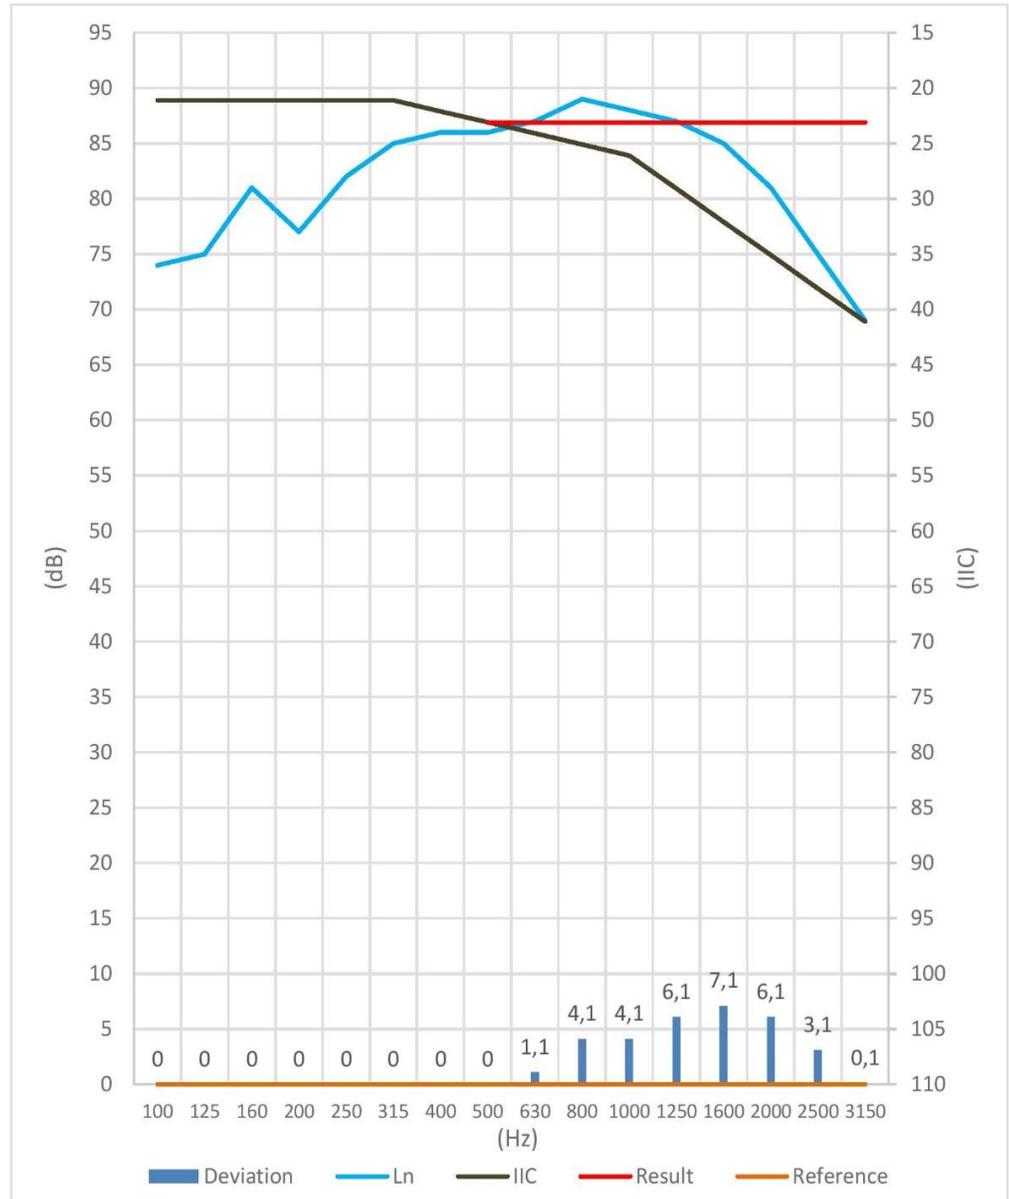

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	74	75	81	77	82	85	86	86	87	89	88	87	85	81	75	69
IIC	88,9	88,9	88,9	88,9	88,9	88,9	87,9	86,9	85,9	84,9	83,9	80,9	77,9	74,9	71,9	68,9
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	75,13	75,49	80,36	76,03	81,71	84,15	84,64	85,09	86,49	86,96	86,87	84,72	81,14	76,56	70,82	64,28
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	0	0	0	0	0	0	0	0	1,1	4,1	4,1	6,1	7,1	6,1	3,1	0,1

Soprema Insonomat

IIC 44

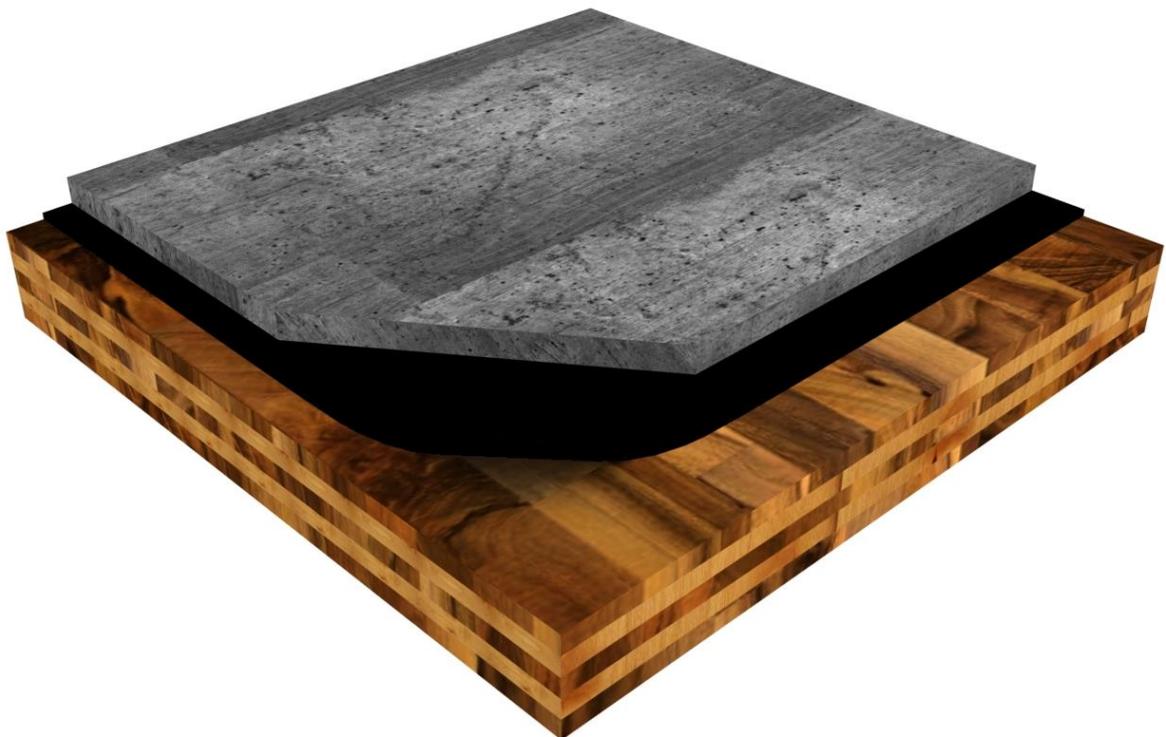

Project : Mass timber comparative study

Test : Test 14 - Bare Concrete(1.5in)

Description :


Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2

Results :

IIC	44
Defavorable deviations	30

Assembly description

Insonomat
CLT 131mm
Thickness w/out CLT: 53mm (2.1in)

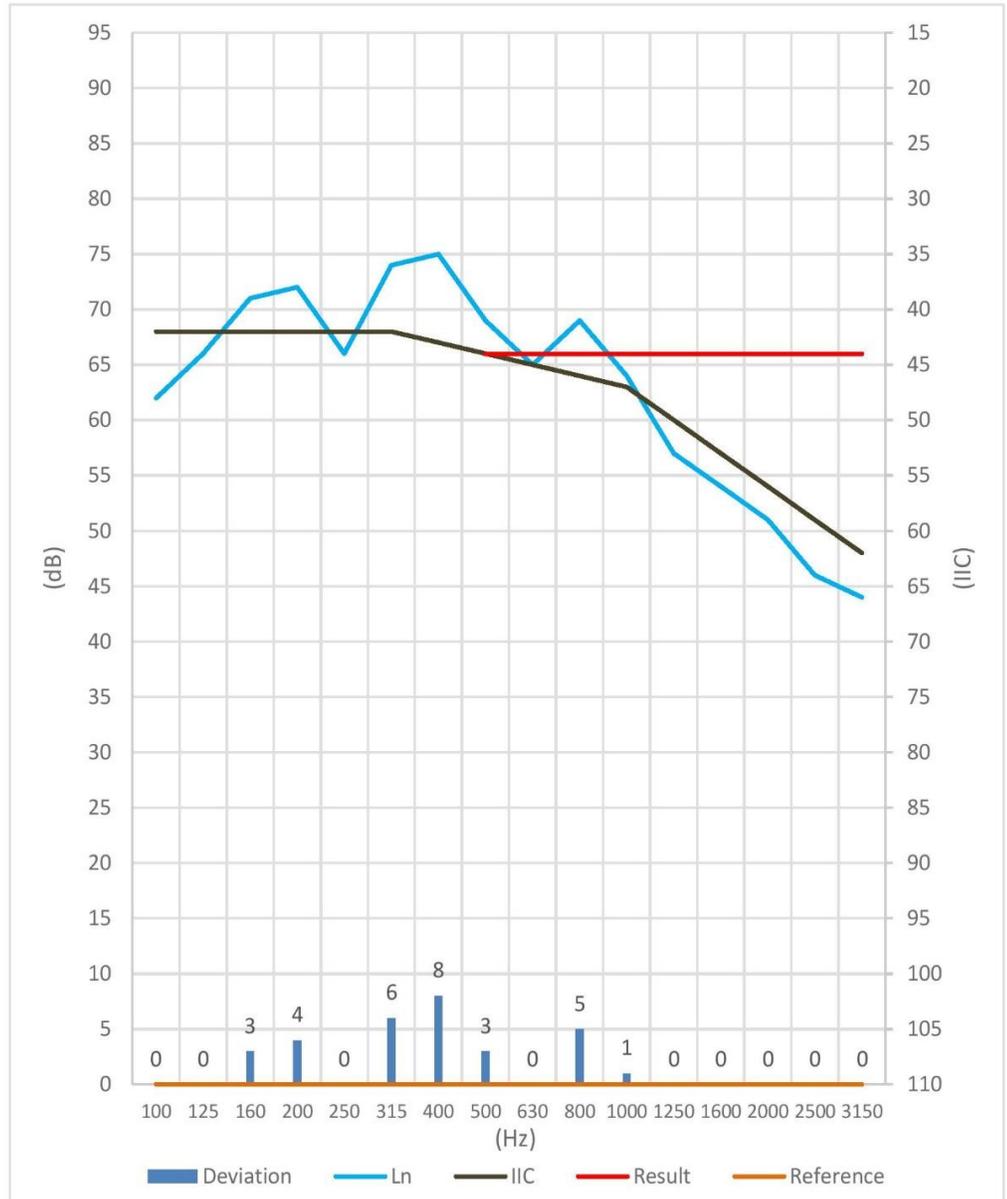

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	62	66	71	72	66	74	75	69	65	69	64	57	54	51	46	44
IIC	68	68	68	68	68	68	67	66	65	64	63	60	57	54	51	48
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	64,02	66,49	70,78	71,44	65,56	72,29	73,5	68,47	64,19	67,33	62,31	54,24	49,85	46,67	41,87	38,59
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	0	0	3	4	0	6	8	3	0	5	1	0	0	0	0	0

Soprema Insonofloor Soprema Insonomat

IIC 49



Project : Mass timber comparative study

Test : Test 15 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	49
Defavorable deviations	16

Assembly description

Insonomat
CLT 131mm


Thickness w/out CLT: 53mm (2.1in)

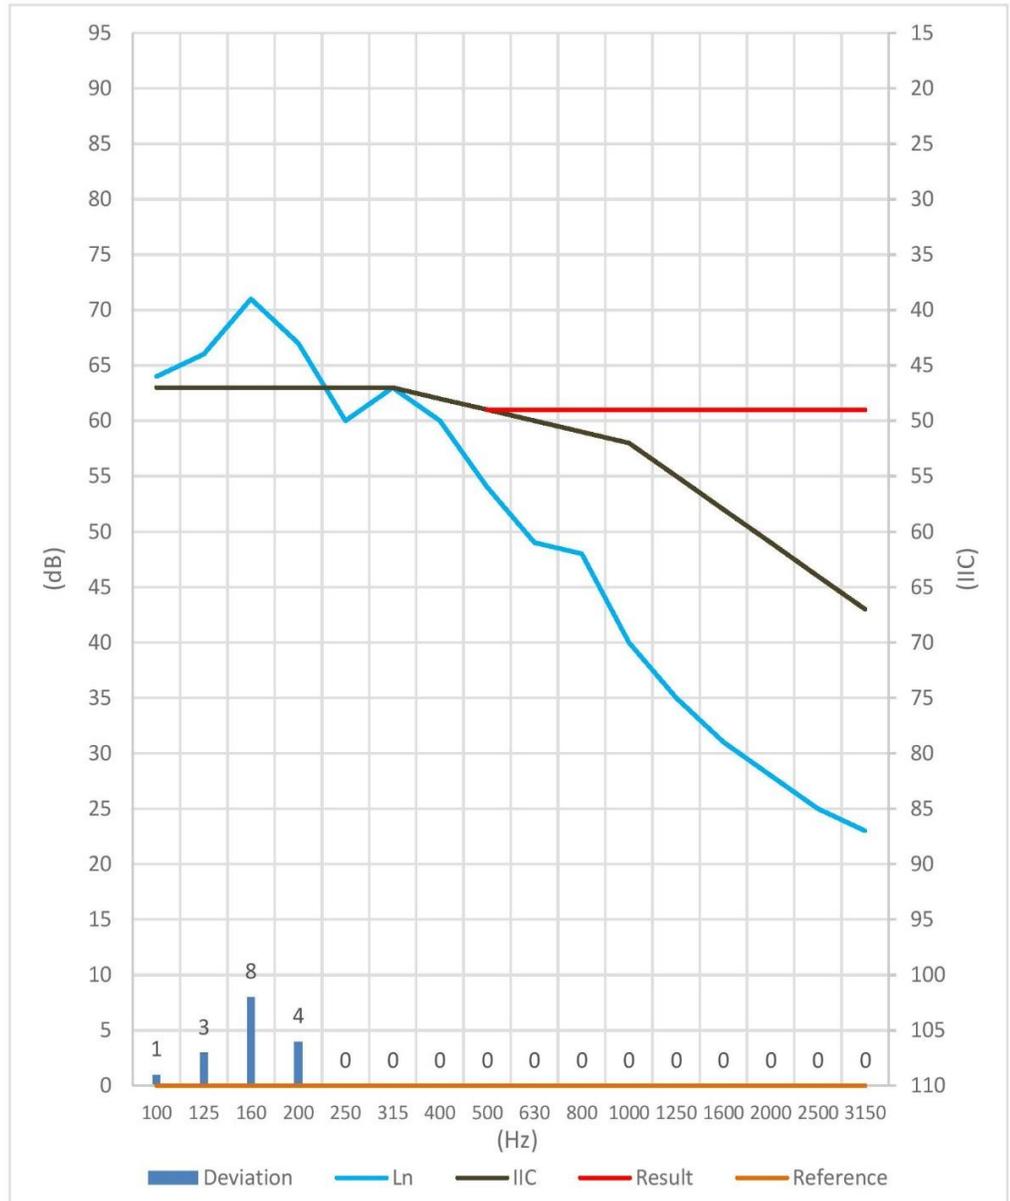

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	64	66	71	67	60	63	60	54	49	48	40	35	31	28	25	23
IIC	63	63	63	63	63	63	62	61	60	59	58	55	52	49	46	43
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	65,3	66,94	70,71	66,82	60,12	61,45	58,31	53,36	48,03	46	38,4	32,61	27,55	23,88	20,19	17,77
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	1	3	8	4	0	0	0	0	0	0	0	0	0	0	0	0

Regupol SonusWave

IIC 47

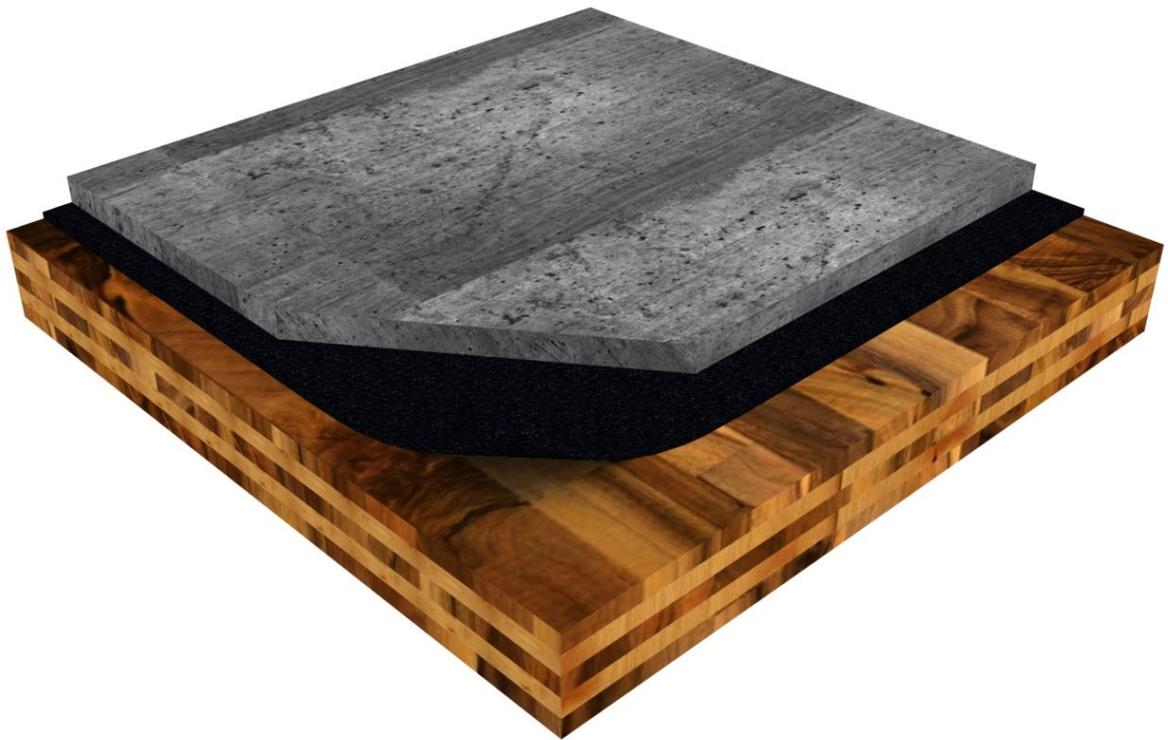

Project : Mass timber comparative study
Test : Test 16 - Bare Concrete(1.5in)

Description :


Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2

Results :

IIC	47
Defavorable deviations	31

Assembly description

SonusWave(17mm)
CLT 131mm
Thickness w/out CLT: 55mm (2.2in)

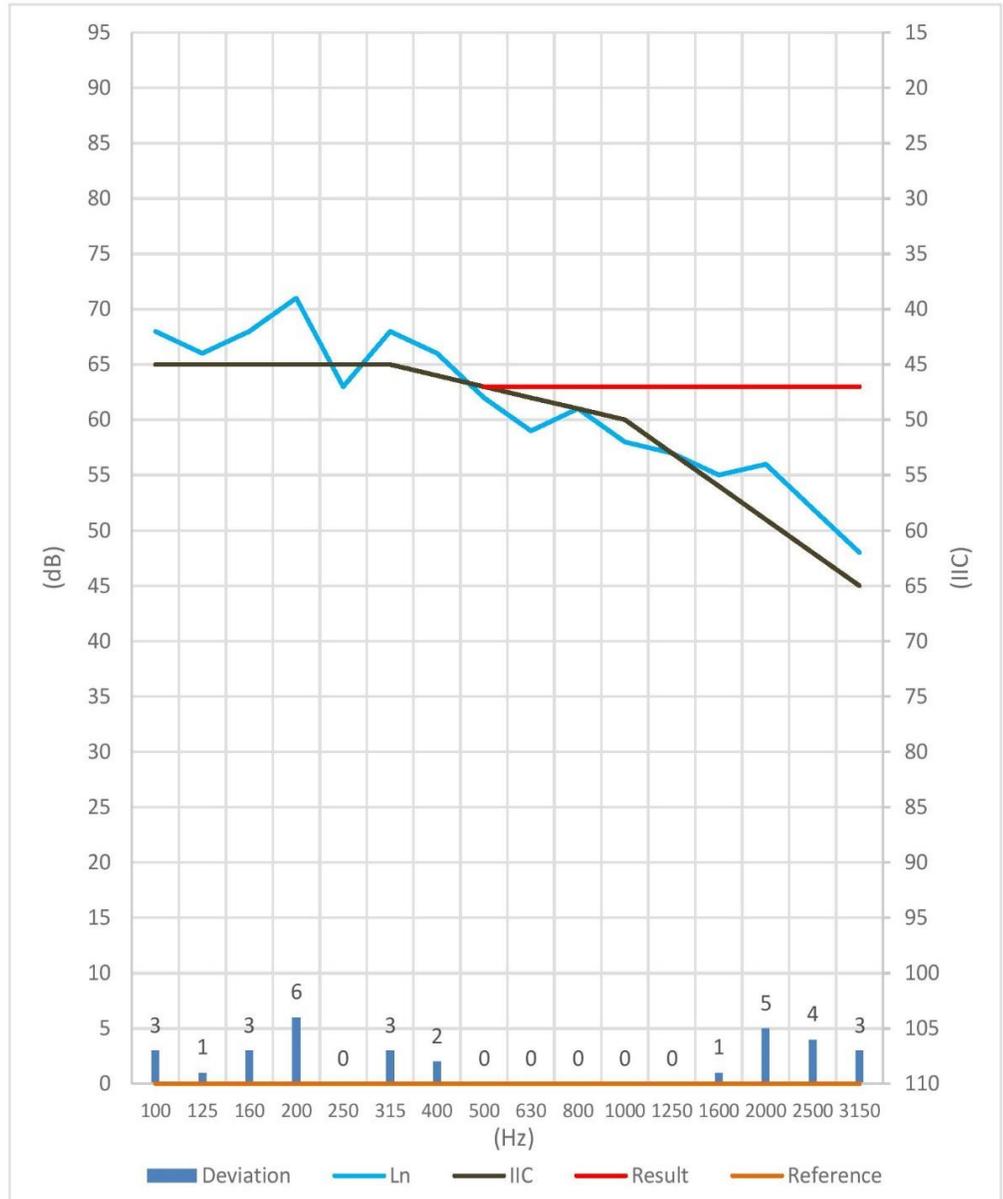

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	68	66	68	71	63	68	66	62	59	61	58	57	55	56	52	48
IIC	65	65	65	65	65	65	64	63	62	61	60	57	54	51	48	45
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	69,2	66,6	67,94	70,32	62,38	66,52	65,06	61	58,37	59,62	56,55	54,52	51,62	51,8	47,37	42,86
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	3	1	3	6	0	3	2	0	0	0	0	0	1	5	4	3

Soprema Insonofloor Regupol SonusWave

IIC 53



Project : Mass timber comparative study

Test : Test 17 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	53
Defavorable deviations	28

Assembly description

SonusWave(17mm)
CLT 131mm

Thickness w/out CLT: 55mm (2.2in)

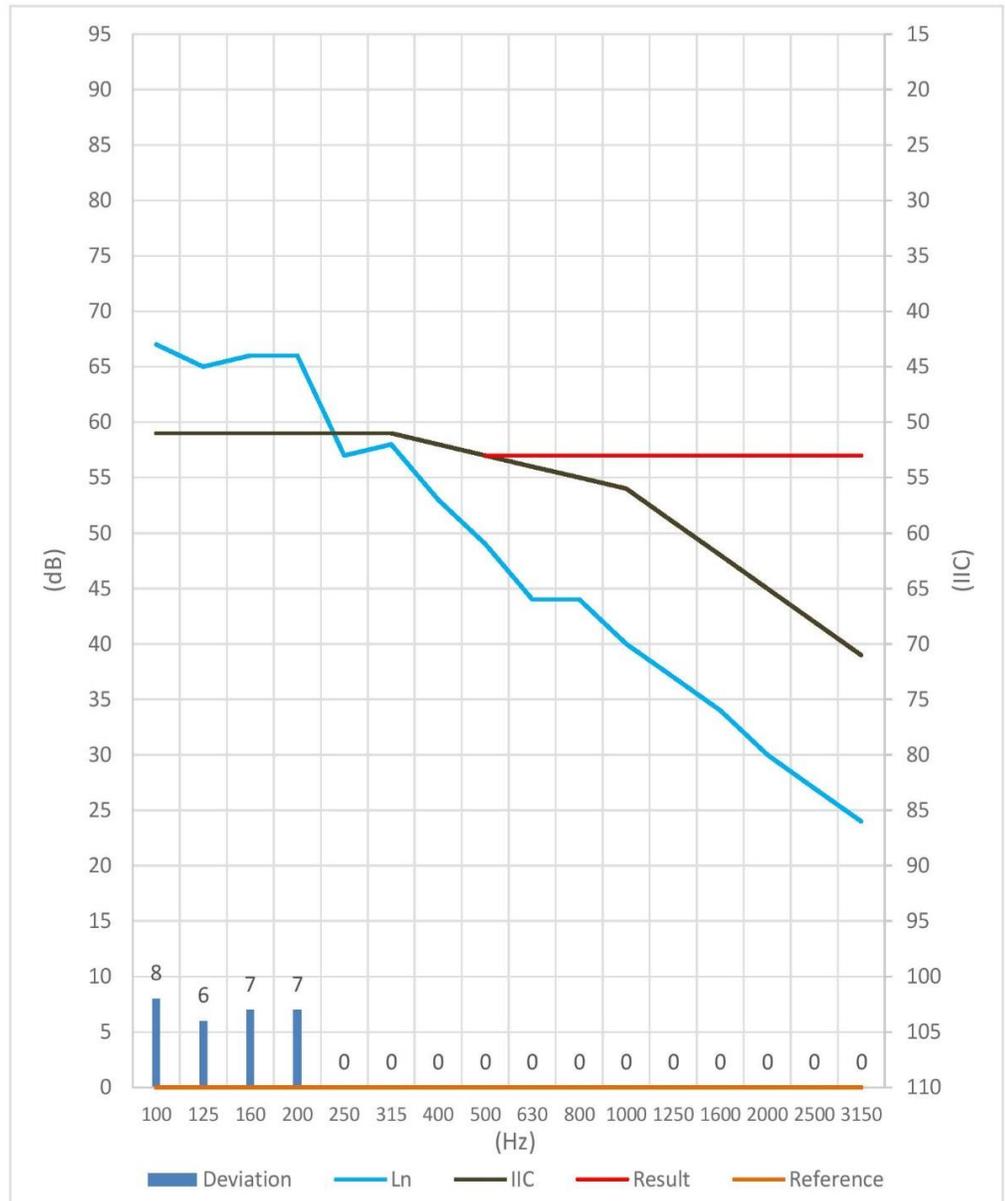

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	67	65	66	66	57	58	53	49	44	44	40	37	34	30	27	24
IIC	59	59	59	59	59	59	58	57	56	55	54	51	48	45	42	39
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	68,95	65,73	65,9	65,8	56,61	56,54	52,19	47,92	43,39	42,68	38,57	34,76	29,88	26,3	22,34	18,79
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	6	7	7	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor Fermacell 2E32

IIC 43



Project : Mass timber comparative study

Test : Test 10 - Soprema Insonofloor+floating floor(8mm)

Description :


Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2

Results :

IIC	43
Defavorable deviations	22

Assembly description

Fermacell 2E32
CLT 131mm
Thickness w/out CLT: 30mm (1.2in)

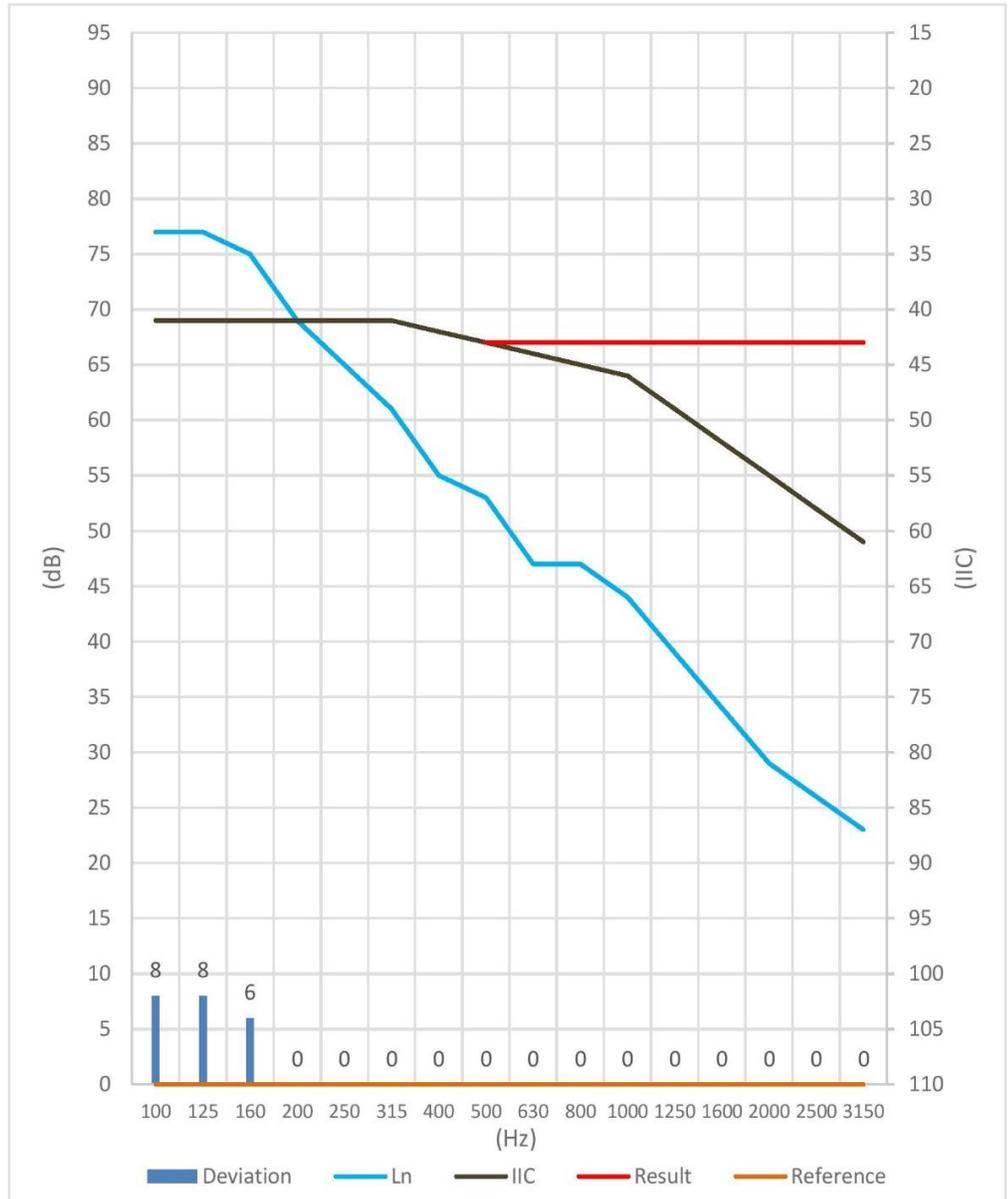

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	77	77	75	69	65	61	55	53	47	47	44	39	34	29	26	23
IIC	69	69	69	69	69	69	68	67	66	65	64	61	58	55	52	49
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	78,76	77,45	74,18	68,16	64,79	59,86	54,19	51,64	46,7	44,95	42,09	36,84	29,87	25,06	20,93	18,06
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	8	6	0	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor Fermacell 12.5 Fermacell 2E32

IIC 44



Project : Mass timber comparative study
Test : Test 11 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	44
Defavorable deviations	18

Assembly description

Fermacell(12.5mm)
Fermacell 2E32
CLT 131mm


Thickness w/out CLT: 43mm (1.7in)

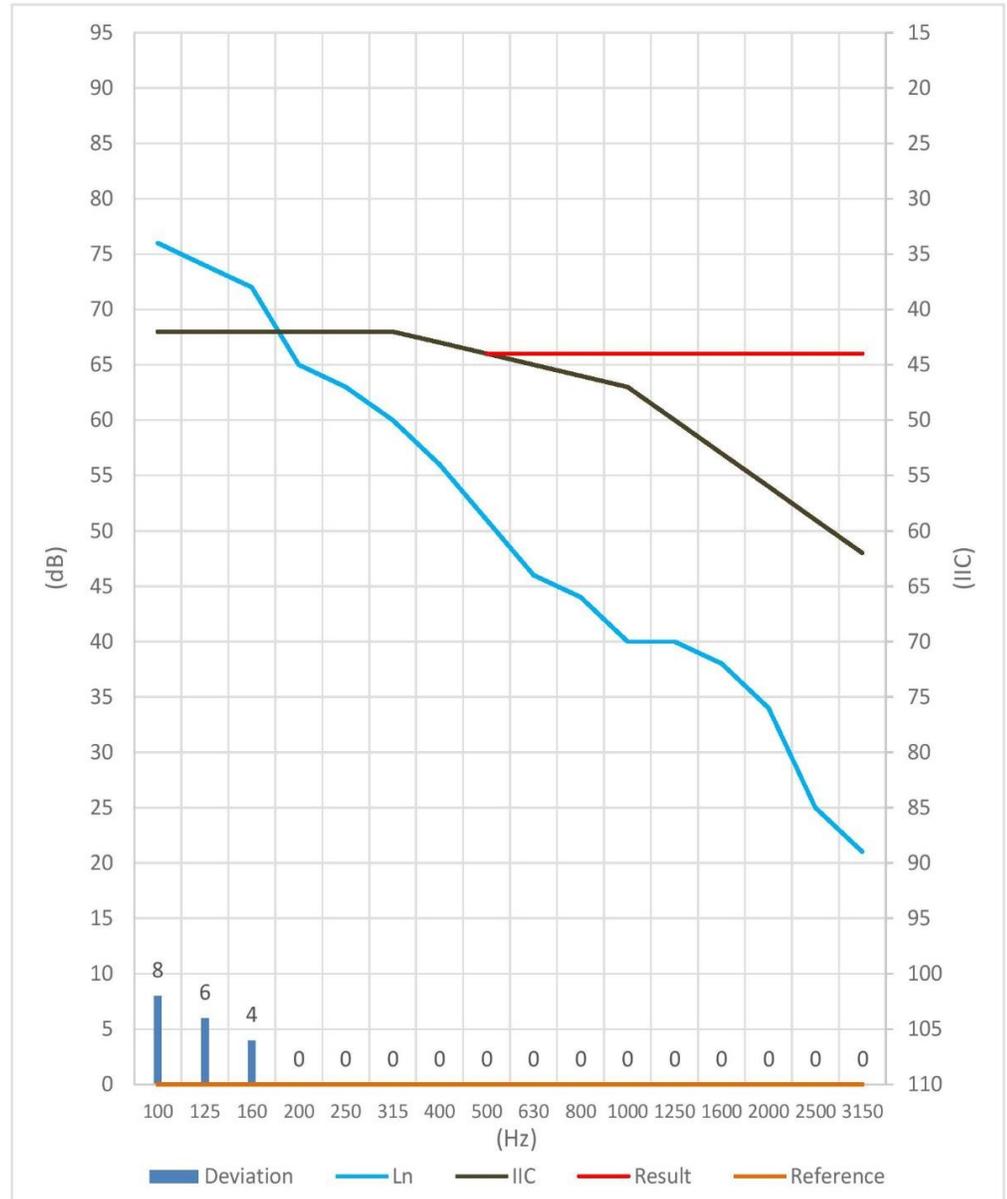

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	76	74	72	65	63	60	56	51	46	44	40	40	38	34	25	21
IIC	68	68	68	68	68	68	67	66	65	64	63	60	57	54	51	48
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	77,46	74,2	71,19	64,86	62,44	58,46	54,57	49,78	45,23	42,45	38,73	37,14	34,49	30,29	20,53	16,72
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	6	4	0	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor
Fermacell 2E32
Fermacell Honeycomb w/ filling

IIC 49

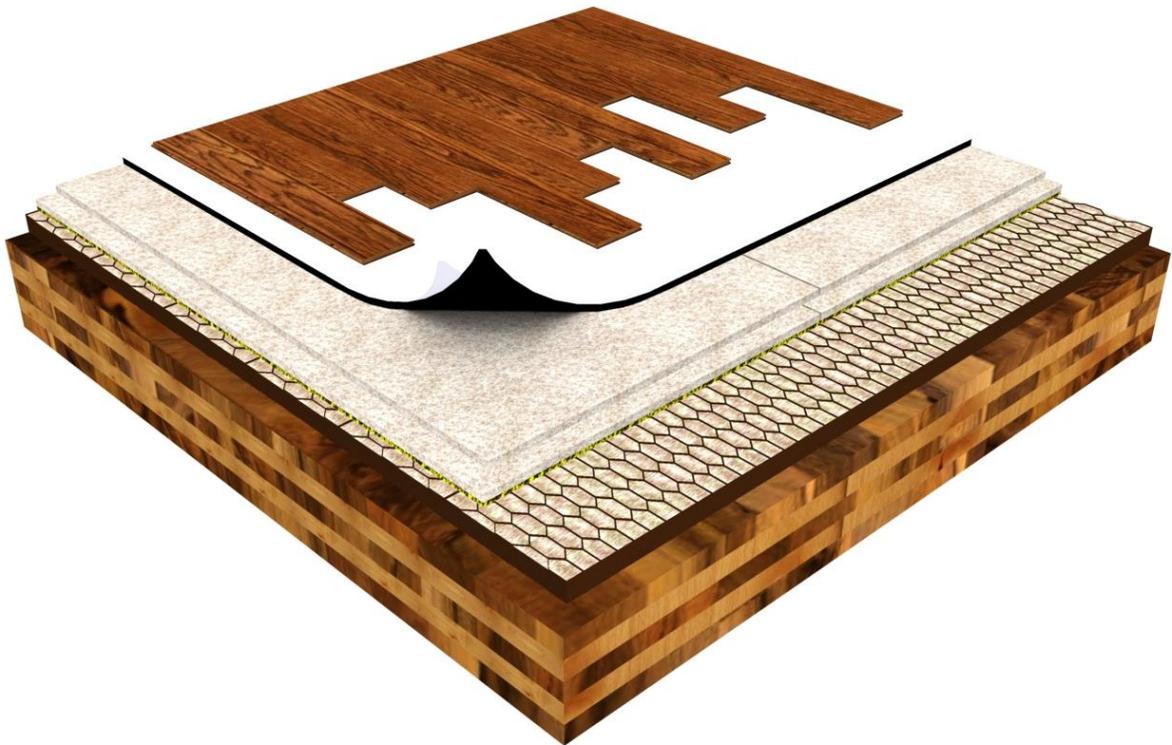

Project : Mass timber comparative study

Test : Test 12 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	49
Defavorable deviations	15

Assembly description

Fermacell 2E32
Granules
Cardboard honeycomb
CLT 131mm


Thickness w/out CLT: 60mm (2.4in)

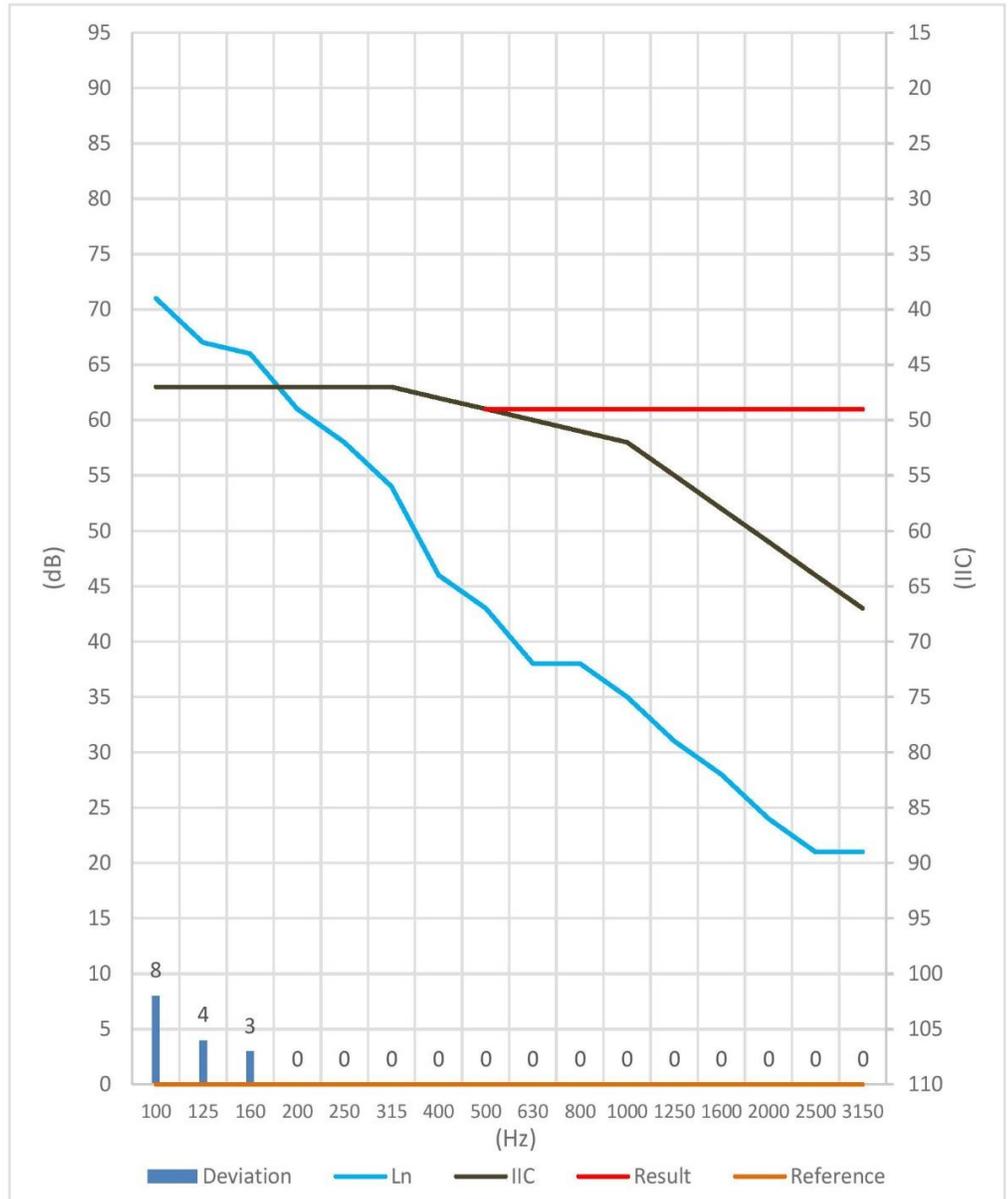

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	71	67	66	61	58	54	46	43	38	38	35	31	28	24	21	21
IIC	63	63	63	63	63	63	62	61	60	59	58	55	52	49	46	43
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	72,93	67,37	65,8	59,92	57,93	53,2	45,24	42,44	37,31	36,45	33,87	28,85	24,26	19,68	17,2	16,38
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	4	3	0	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor
Fermacell 12.5
Fermacell 2E32
Fermacell Honeycomb w/ filling

IIC 50

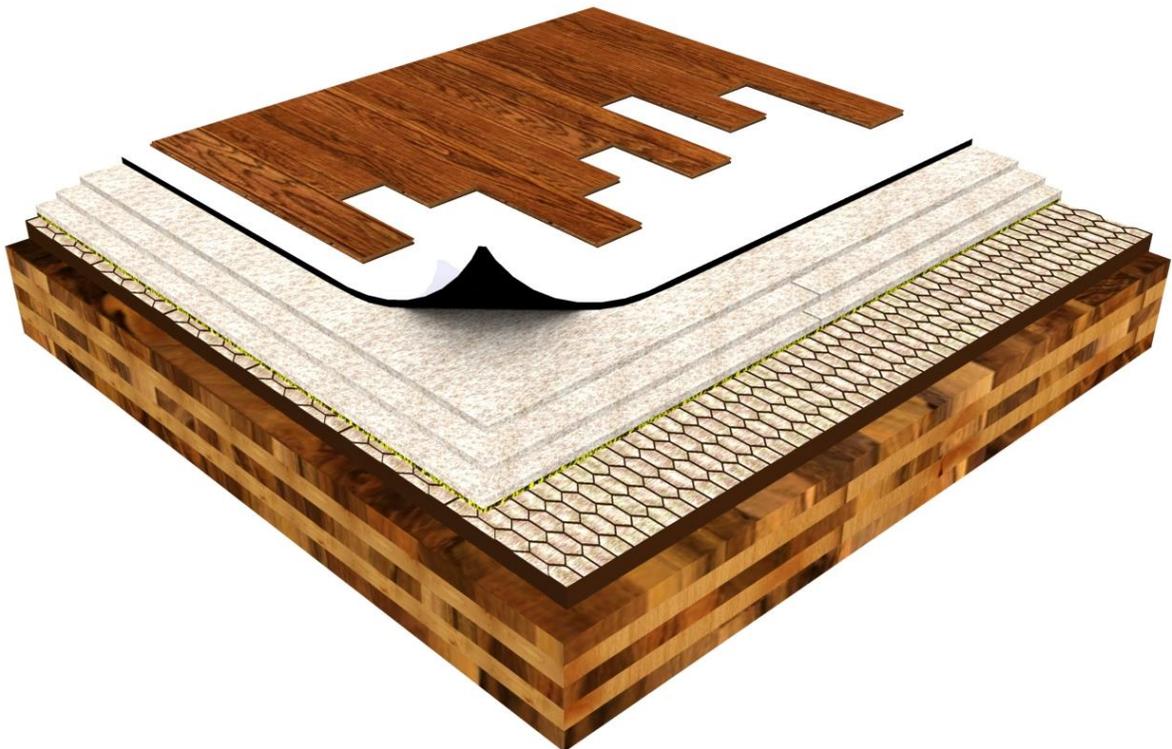

Project : Mass timber comparative study

Test : Test 13 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	50
Defavorable deviations	18

Assembly description

Fermacell(12.5mm)
Fermacell 2E32
Granules
Cardboard honeycomb
CLT 131mm

Thickness w/out CLT: 73mm (2.9in)

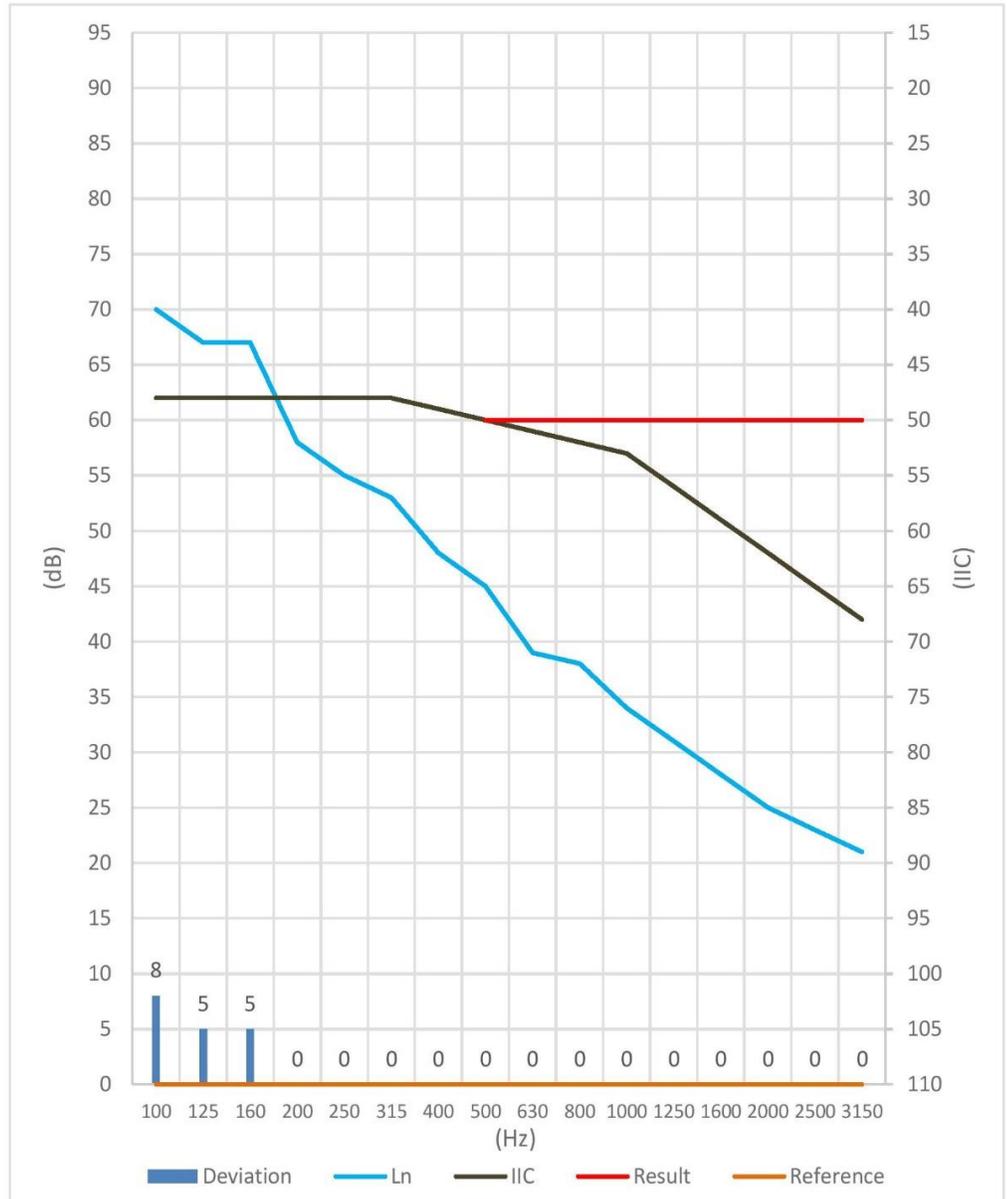

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	70	67	67	58	55	53	48	45	39	38	34	31	28	25	23	21
IIC	62	62	62	62	62	62	61	60	59	58	57	54	51	48	45	42
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	71,24	67,3	66,11	57,31	55,24	51,92	47,24	43,62	38,42	36,34	32,34	28,75	24,57	20,92	18,73	16,48
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	5	5	0	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor

5/8" Permabase cement board

3/4" Permabase cement board

SONO/MAX 25

IIC 45



Project : Mass timber comparative study

Test : Test 18 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	45
Defavorable deviations	19

Assembly description

Permabase(0.625in)
Permabase(0.75in)
Sonomax25(fiberboard only)
CLT 131mm

Thickness w/out CLT: 60mm (2.4in)

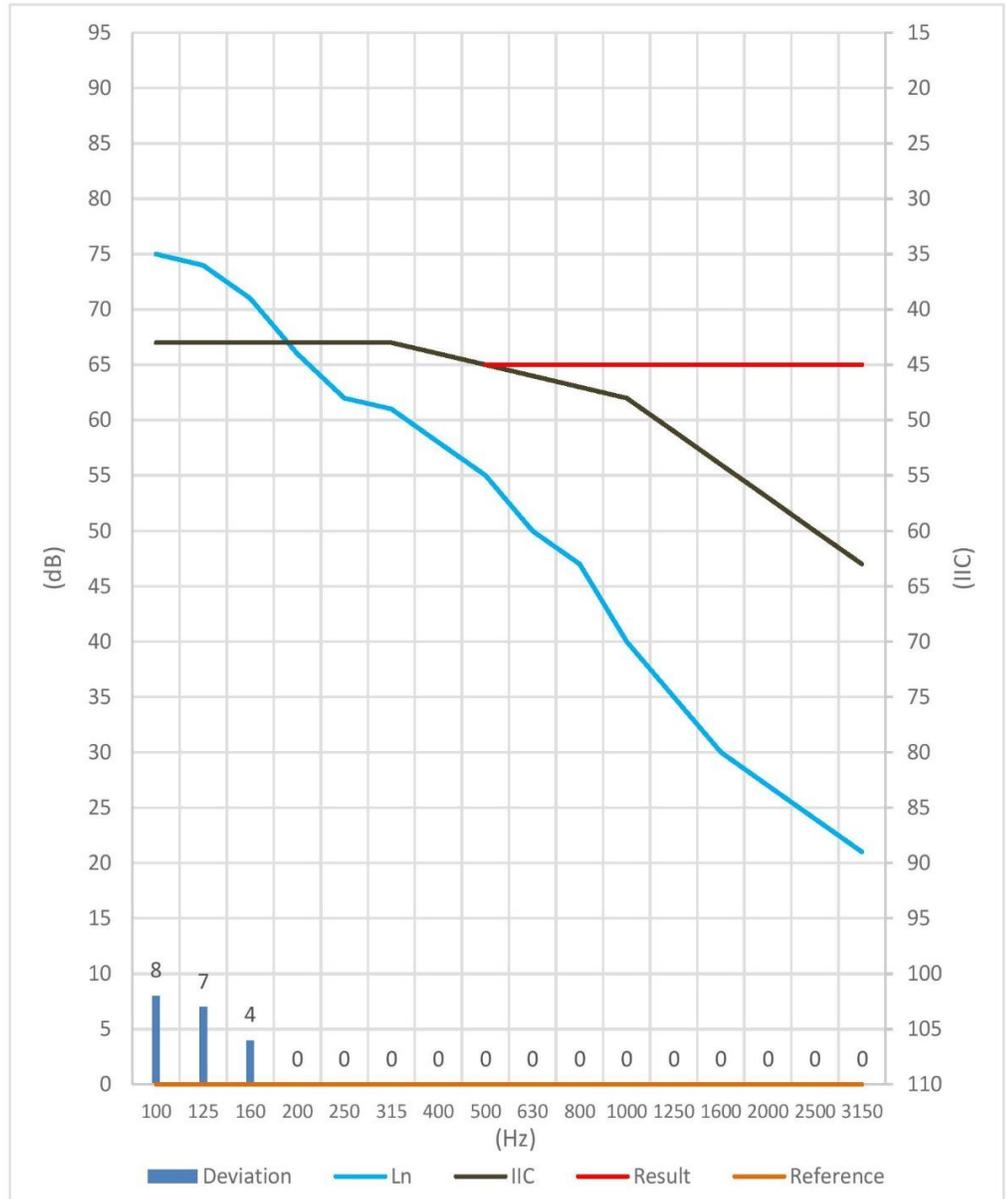

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	75	74	71	66	62	61	58	55	50	47	40	35	30	27	24	21
IIC	67	67	67	67	67	67	66	65	64	63	62	59	56	53	50	47
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	76,2	74,27	70,46	65,06	62,05	59,36	57,16	53,61	49,1	45,02	38,66	32,05	25,84	22,67	19,06	16,16
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	7	4	0	0	0	0	0	0	0	0	0	0	0	0	0

Soprema Insonofloor
1/2" Plywood
5/8" Plywood
AcoustiTECH SOFIX

IIC 51



Project : Mass comparative study

Test : Test 22 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40


Results :

IIC	51
Defavorable deviations	22

Assembly description

plywood(0.5in)
plywood(0.625in)
AcoustiTECH SOFIX
CLT 131mm


Thickness w/out CLT: 67mm (2.6in)

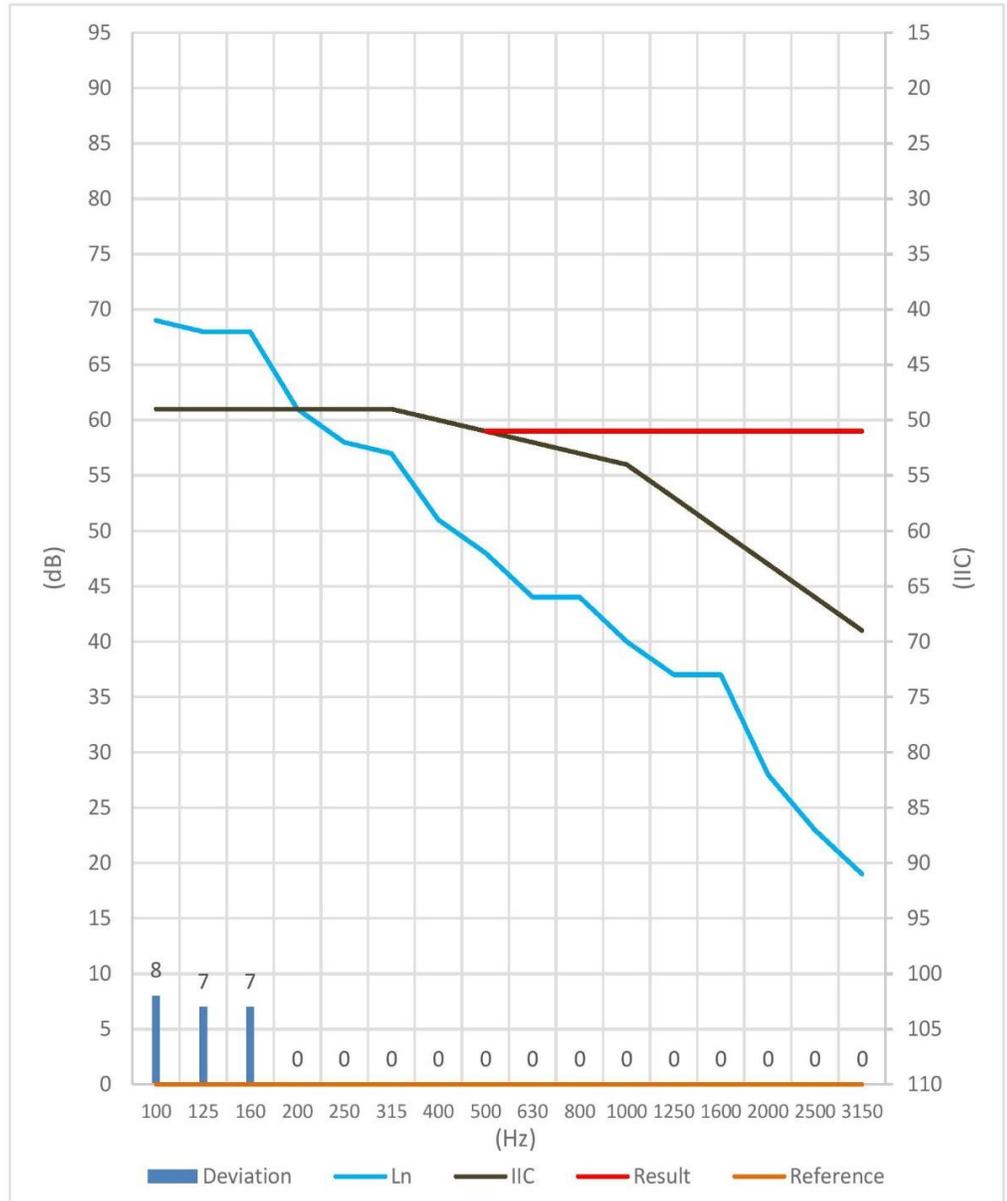

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	69	68	68	61	58	57	51	48	44	44	40	37	37	28	23	19
IIC	61	61	61	61	61	61	60	59	58	57	56	53	50	47	44	41
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	70,62	68,55	67,84	60,84	57,76	55,69	50,01	47,55	44	42,14	38,77	34,53	32,97	24,34	18,22	14,84
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	7	7	0	0	0	0	0	0	0	0	0	0	0	0	0

AcoustiTECH Ceramic
5/8" OSB
5/8" OSB
AcoustiTECH SOFIX

IIC 54

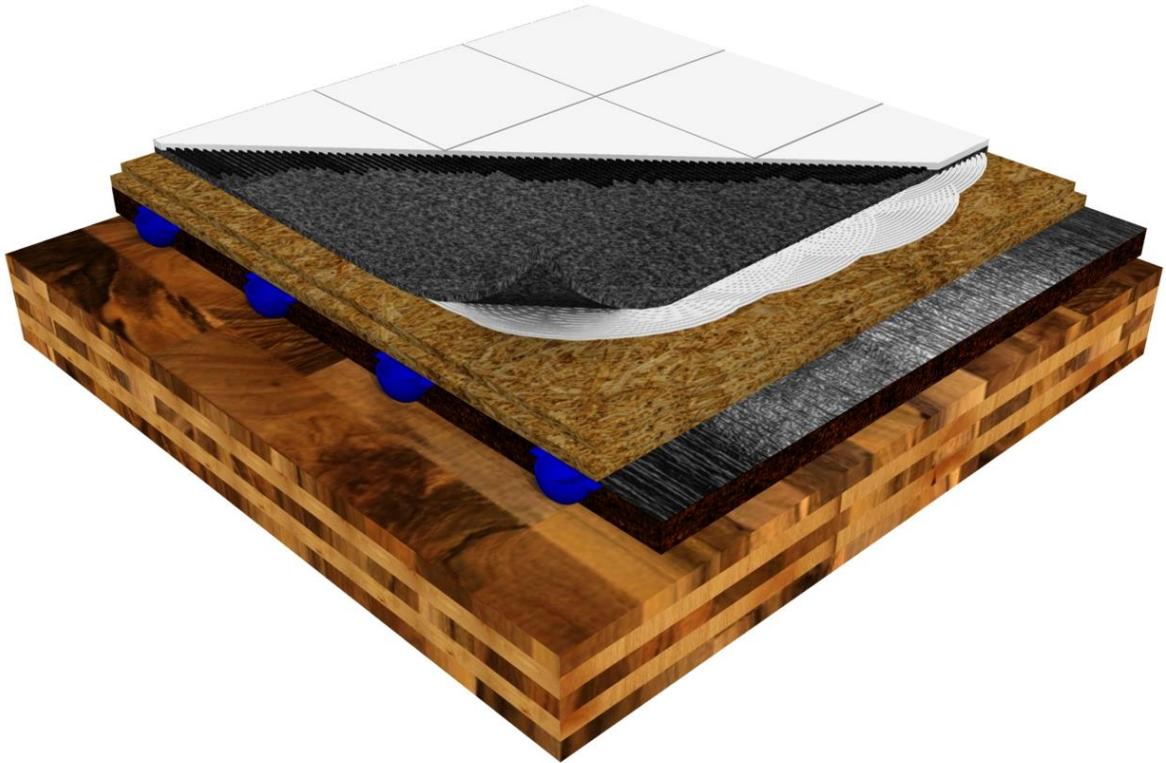

Project : Mass timber comparative study
Test : Test 19 - AcoustiTECH Ceramic+Ceramic

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	54,9
Defavorable deviations	32

Assembly description

OSB(0.625in)
OSB(0.625in)
AcoustiTECH SOFIX
CLT 131mm


Thickness w/out CLT: 70mm (2.8in)

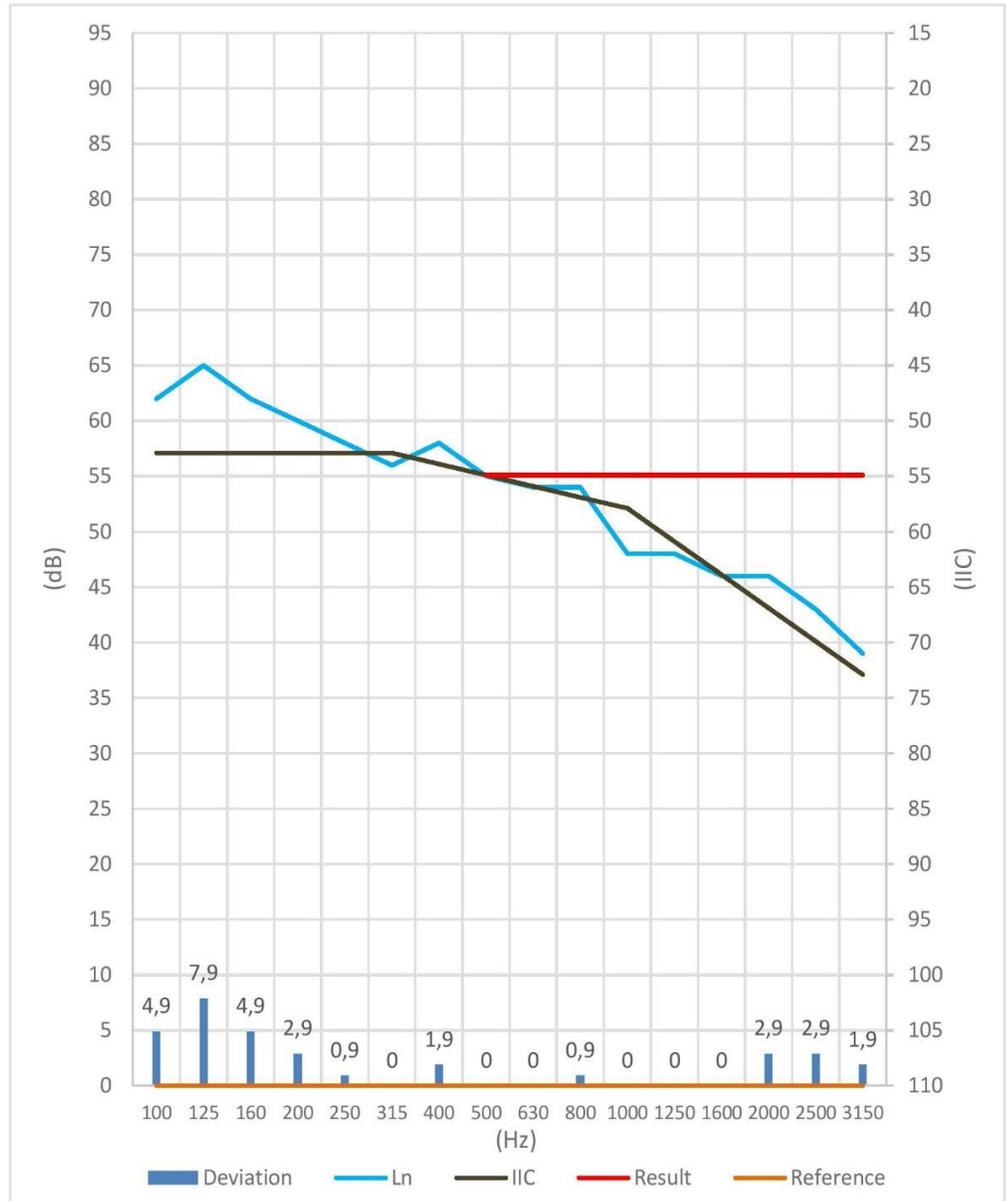

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	62	65	62	60	58	56	58	55	54	54	48	48	46	46	43	39
IIC	57,1	57,1	57,1	57,1	57,1	57,1	56,1	55,1	54,1	53,1	52,1	49,1	46,1	43,1	40,1	37,1
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	63,6	65,2	61,49	59,81	58,22	54,99	56,83	53,77	53,27	52,11	46,84	45,66	42,16	41,51	38,08	33,9
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	4,9	7,9	4,9	2,9	0,9	0	1,9	0	0	0,9	0	0	0	2,9	2,9	1,9

AcoustiTECH Ceramic
5/8" OSB
5/8" OSB
AcoustiTECH SOFIX
AcoustiTECH LEAD 6

IIC 58

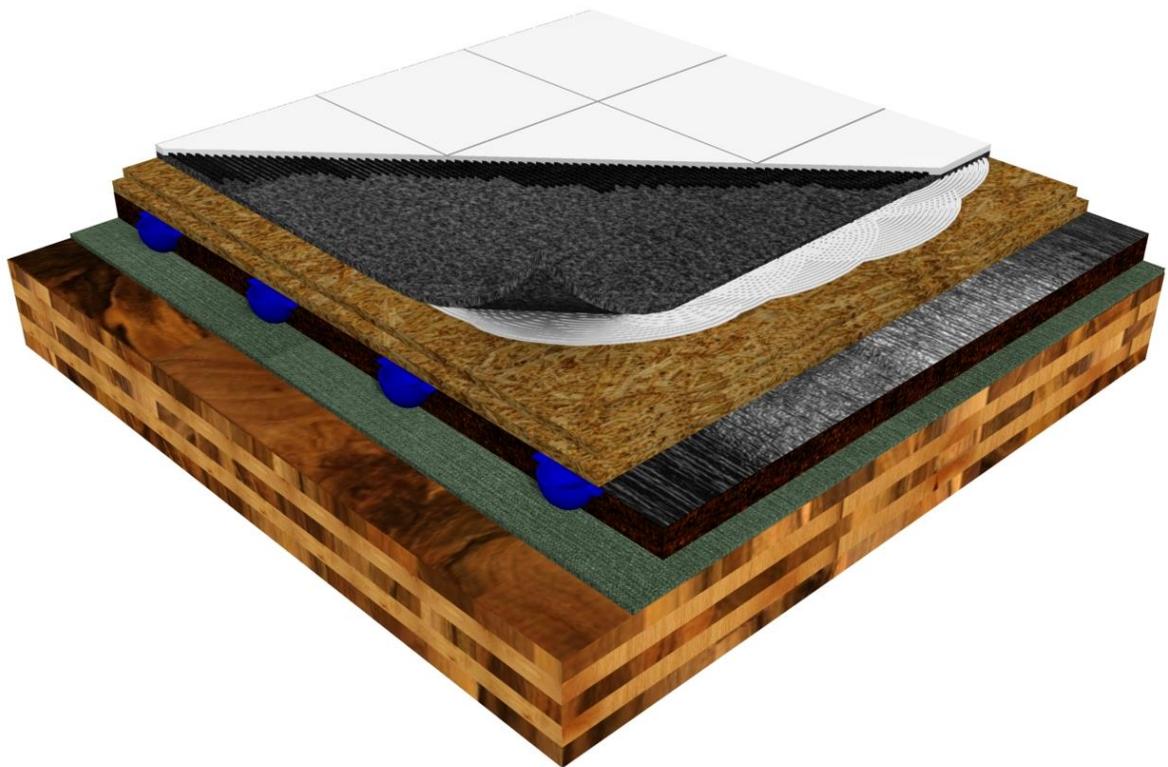

Project : Mass timber comparative study
Test : Test 20 - AcoustiTECH Ceramic+Ceramic

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	58
Defavorable deviations	31

Assembly description

OSB(0.625in)
OSB(0.625in)
AcoustiTECH SOFIX
AcoustiTECH Lead 6
CLT 131mm


Thickness w/out CLT: 76mm (3in)

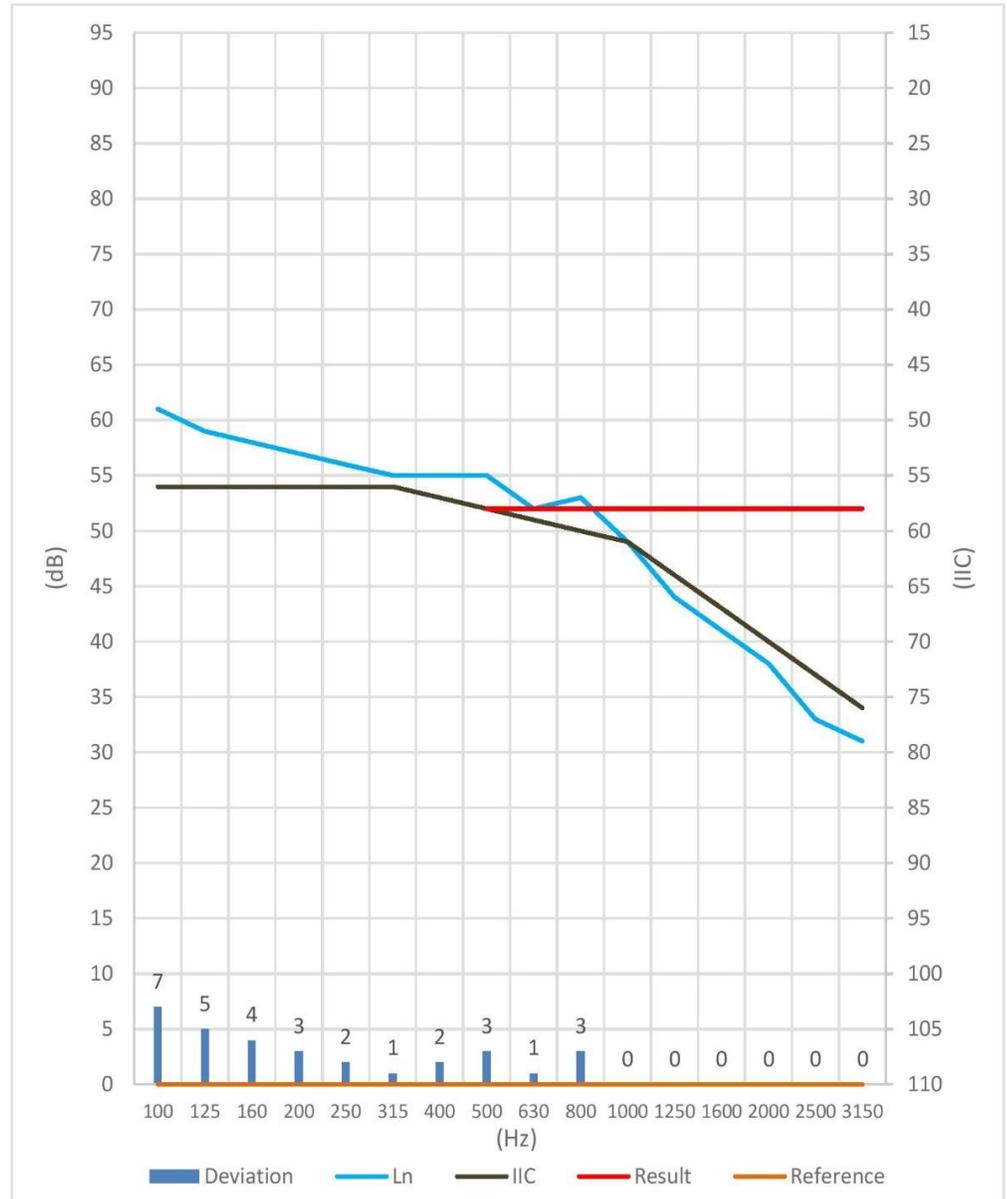

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	61	59	58	57	56	55	55	55	52	53	49	44	41	38	33	31
IIC	54	54	54	54	54	54	53	52	51	50	49	46	43	40	37	34
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	62,24	59,57	57,56	56,16	55,46	53,4	54,17	54,13	51,09	51,32	47,12	41,14	36,9	33,67	28,03	25,91
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	7	5	4	3	2	1	2	3	1	3	0	0	0	0	0	0

Soprema Insonofloor
1/2" Plywood
5/8" Plywood
AcoustiTECH SOFIX
AcoustiTECH LEAD 6
1 1/2" standard concrete

IIC 58

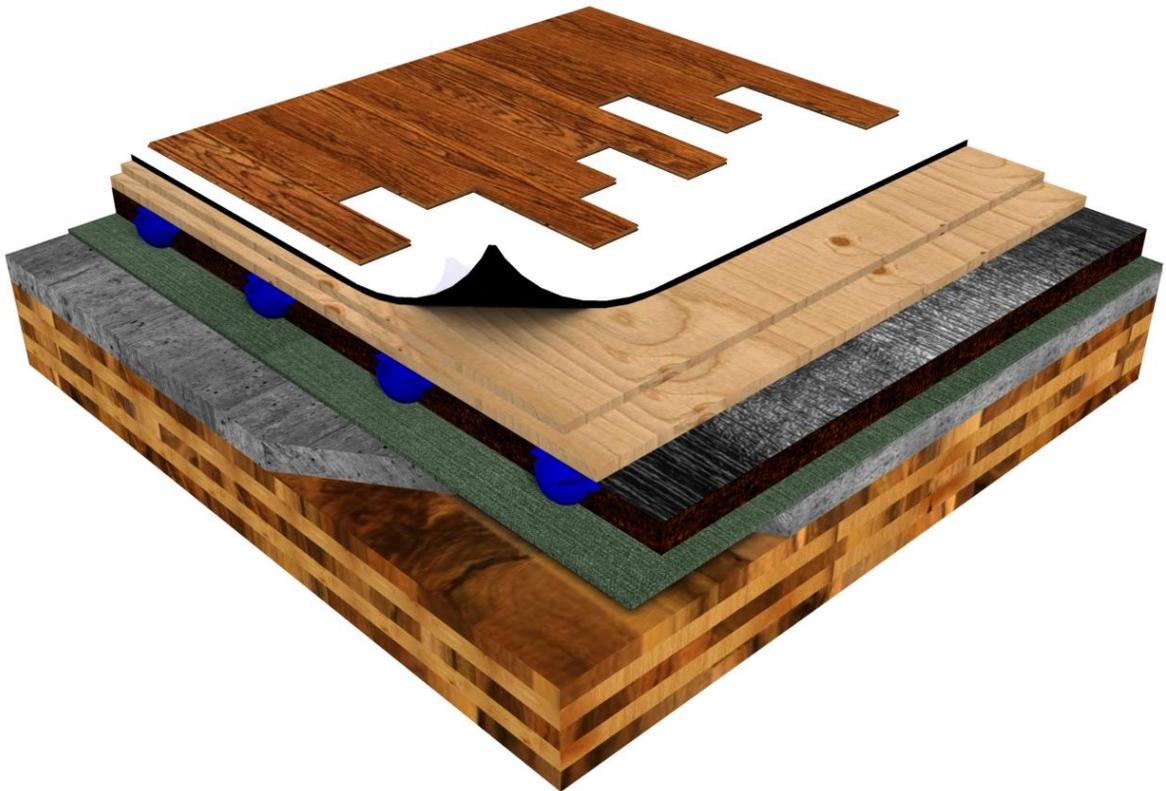

Project : Mass comparative study

Test : Test 29 - Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40


Results :

IIC	58
Defavorable deviations	21

Assembly description

plywood(0.5in)
plywood(0.625in)
AcoustiTECH SOFIX
AcoustiTECH Lead 6
Concrete(1.5in)
CLT 131mm


Thickness w/out CLT: 111mm (4.4in)

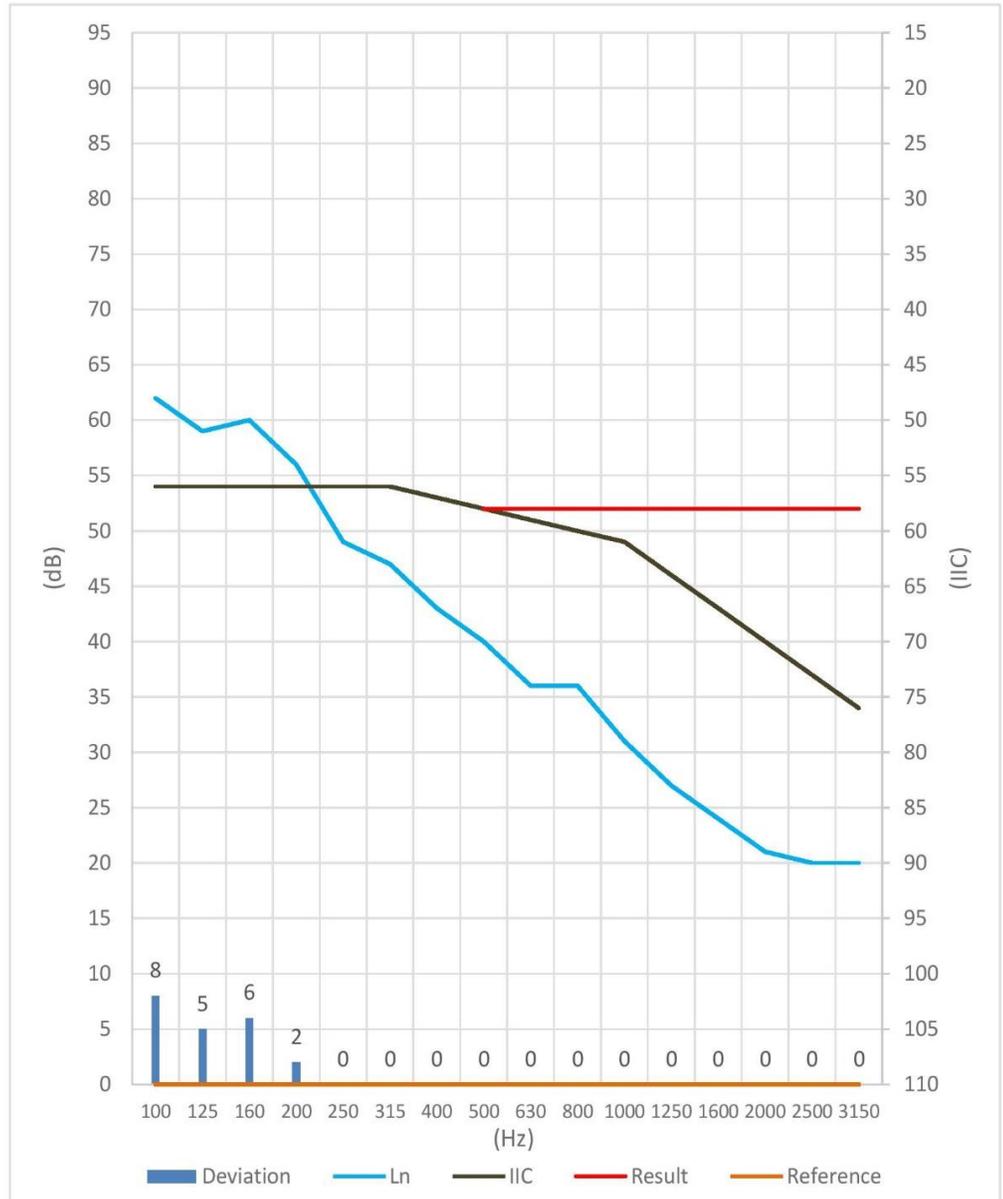

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	62	59	60	56	49	47	43	40	36	36	31	27	24	21	20	20
IIC	54	54	54	54	54	54	53	52	51	50	49	46	43	40	37	34
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	63,49	59,35	59,5	55,58	49,31	45,69	41,58	39,67	35,98	34,28	29,63	24,92	20,76	17,8	16,27	15,78
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	5	6	2	0	0	0	0	0	0	0	0	0	0	0	0

AcoustiTECH Ceramic
5/8" OSB
5/8" OSB
AcoustiTECH SOFIX
1 1/2" standard concrete

IIC 60

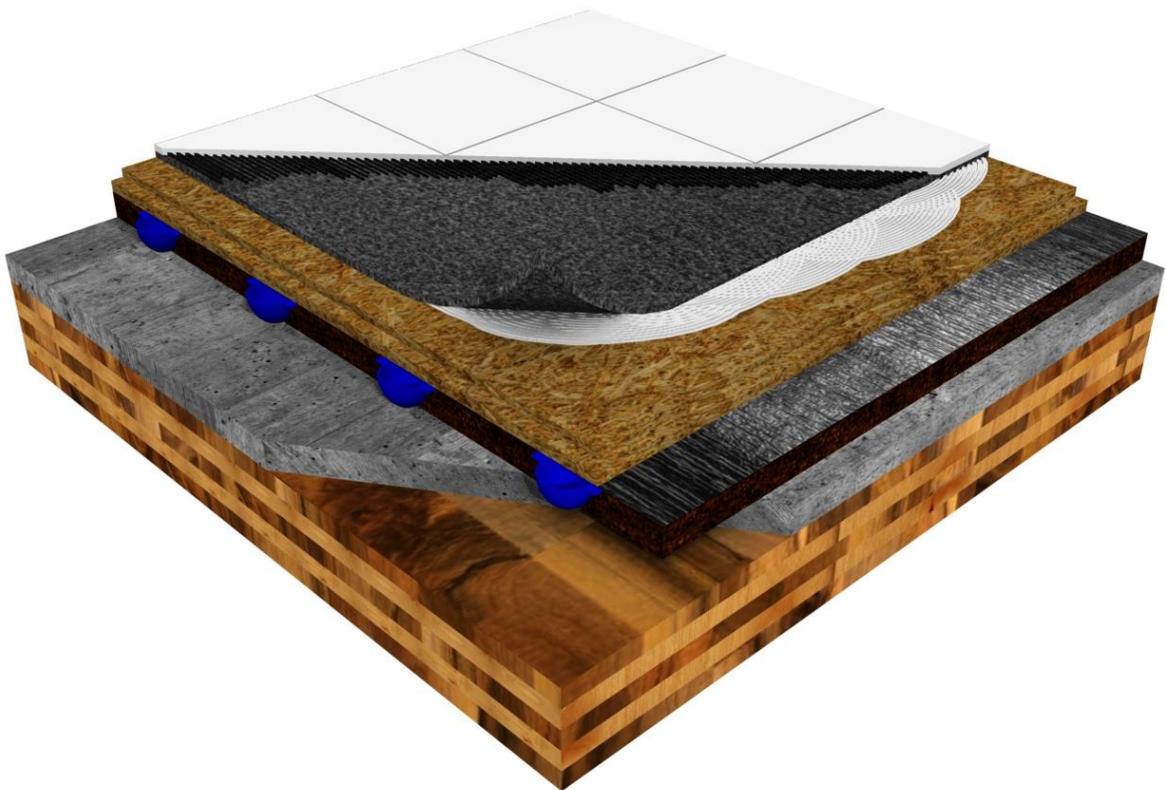

Project : Mass comparative study
Test : Test 27 - AcoustiTECH Ceramic+Ceramic

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40


Results :

IIC	60,1
Defavorable deviations	31,8

Assembly description

OSB(0.625in)
OSB(0.625in)
AcoustiTECH SOFIX
Concrete(1.5in)
CLT 131mm


Thickness w/out CLT: 108mm (4.3in)

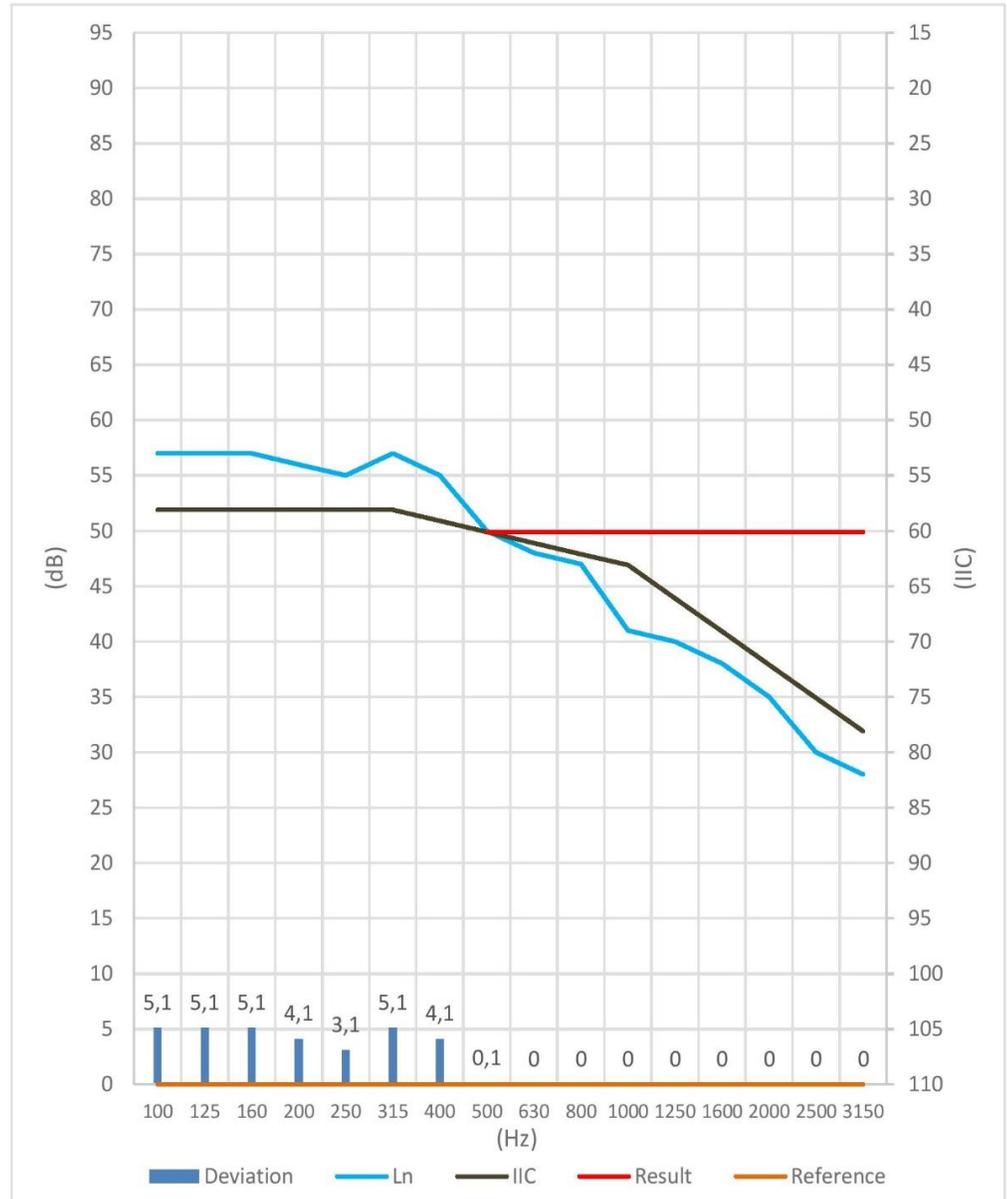

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	57	57	57	56	55	57	55	50	48	47	41	40	38	35	30	28
IIC	51,9	51,9	51,9	51,9	51,9	51,9	50,9	49,9	48,9	47,9	46,9	43,9	40,9	37,9	34,9	31,9
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	58,89	57,44	56,7	55,81	55,04	55,49	53,84	49,36	47,27	45,98	40,11	37,76	34,85	30,76	25,93	22,95
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	5,1	5,1	5,1	4,1	3,1	5,1	4,1	0,1	0	0	0	0	0	0	0	0

AcoustiTECH Ceramic
5/8" OSB
5/8" OSB
AcoustiTECH SOFIX
AcoustiTECH LEAD 6
1 1/2" standard concrete

IIC 63

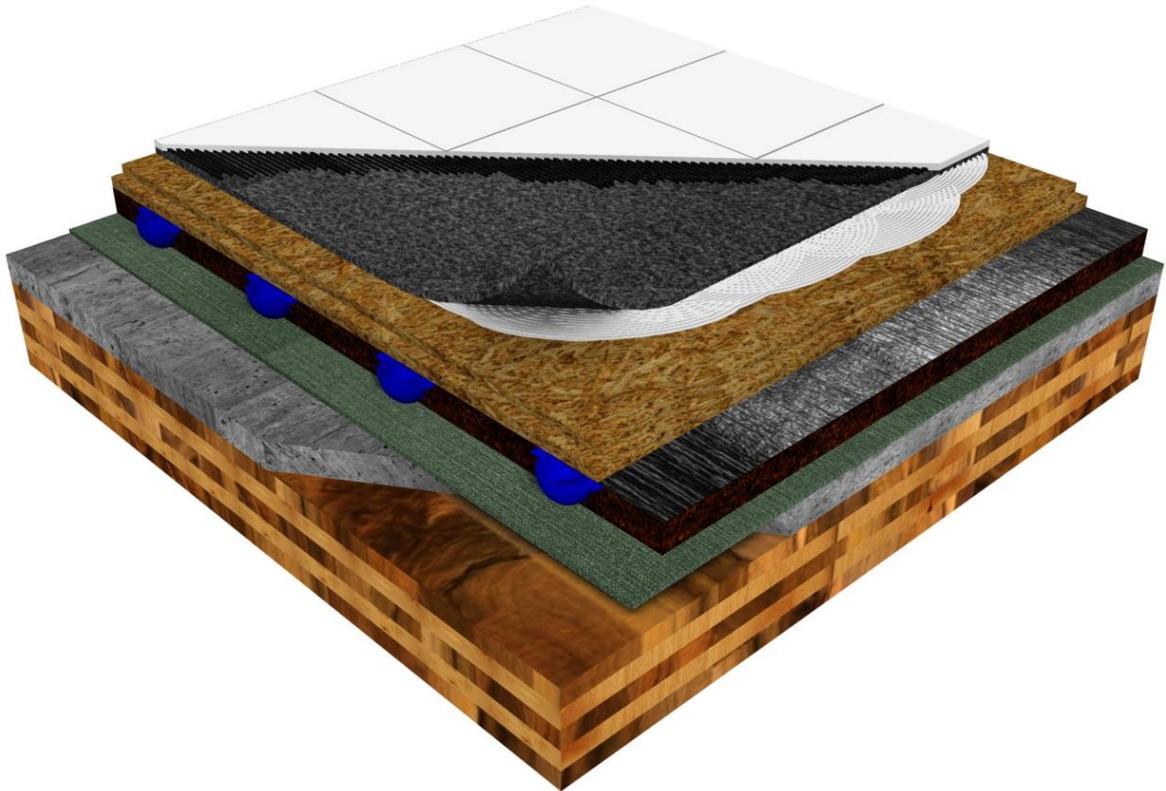

Project : Mass comparative study

Test : Test 28 - AcoustiTECH Ceramic+Ceramic

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40


Results :

IIC	63,7
Defavorable deviations	31,6

Assembly description

OSB(0.625in)
OSB(0.625in)
AcoustiTECH SOFIX
AcoustiTECH Lead 6
Concrete(1.5in)
CLT 131mm


Thickness w/out CLT: 114mm (4.5in)

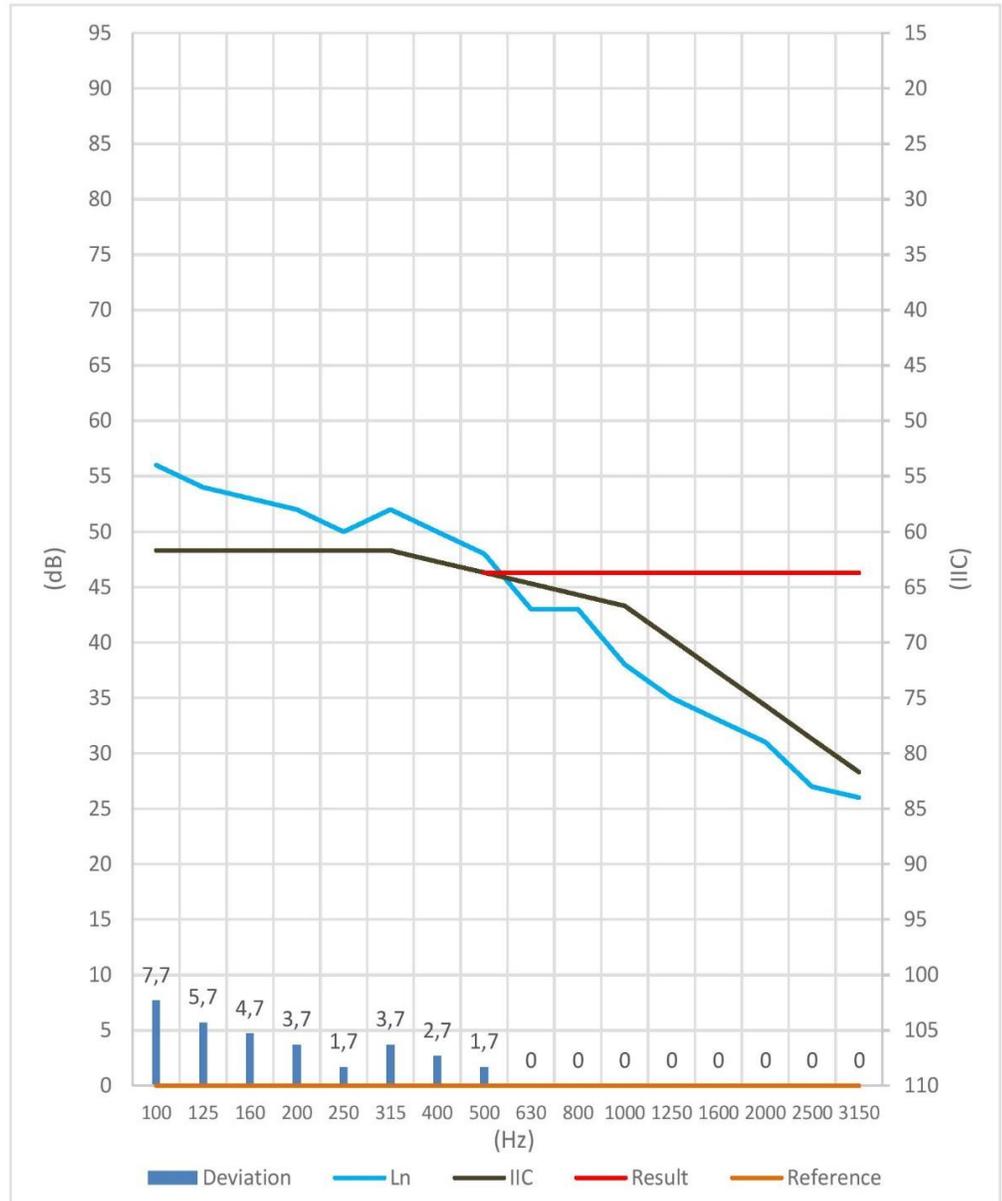

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	56	54	53	52	50	52	50	48	43	43	38	35	33	31	27	26
IIC	48,3	48,3	48,3	48,3	48,3	48,3	47,3	46,3	45,3	44,3	43,3	40,3	37,3	34,3	31,3	28,3
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	57,58	54,75	52,22	51,71	50,32	50,49	48,81	47,66	42,54	41,42	37,05	32,95	29,39	26,89	22,98	20,81
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	7,7	5,7	4,7	3,7	1,7	3,7	2,7	1,7	0	0	0	0	0	0	0	0

Soprema Insonofloor
1/2" Plywood
5/8" Plywood
AcoustiTECH SOFIX
1 1/2" standard concrete
Soprema Insonomat

IIC 57

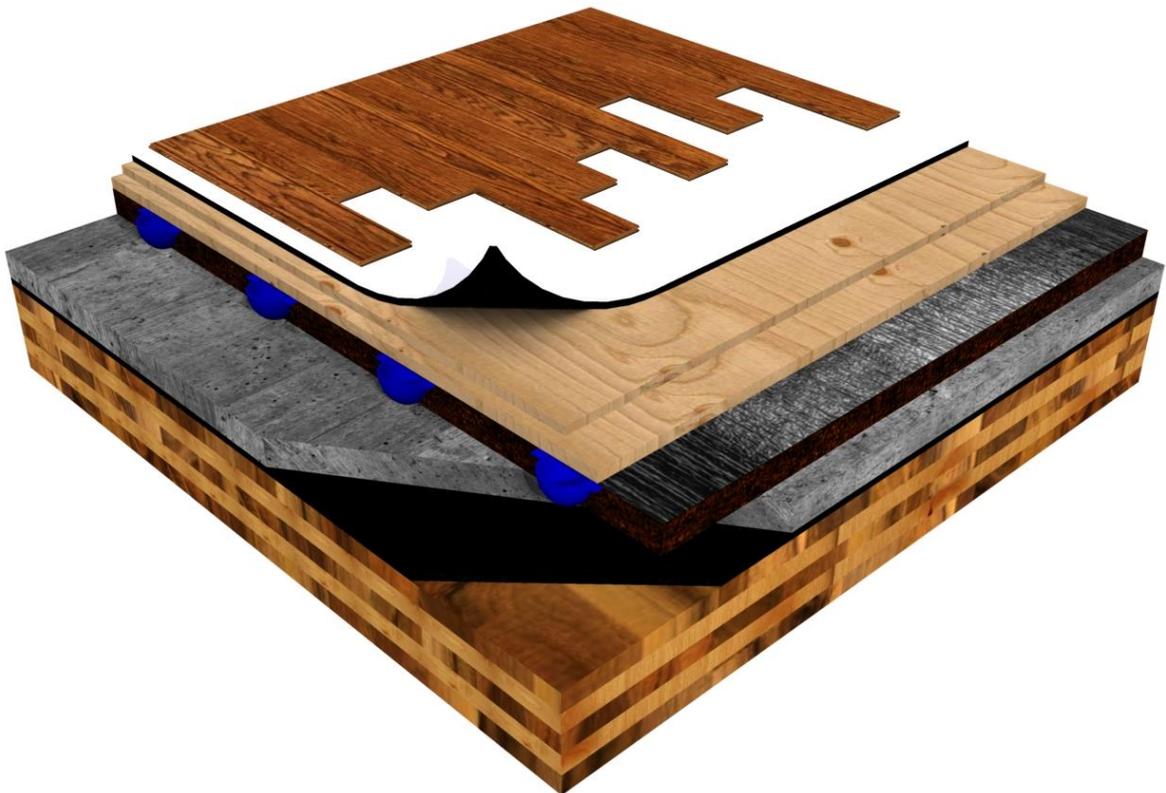


Project : Mass comparative study
Test : Test 32 - Soprema Insonofloor+floating floor(8mm)

Description :	
Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40

Results :	
IIC	57
Defavorable deviations	19

Assembly description
plywood(0.5in)
plywood(0.625in)
AcoustiTECH SOFIX
Concrete(1.5in)
Insonomat
CLT 131mm
Thickness w/out CLT: 120mm (4.7in)

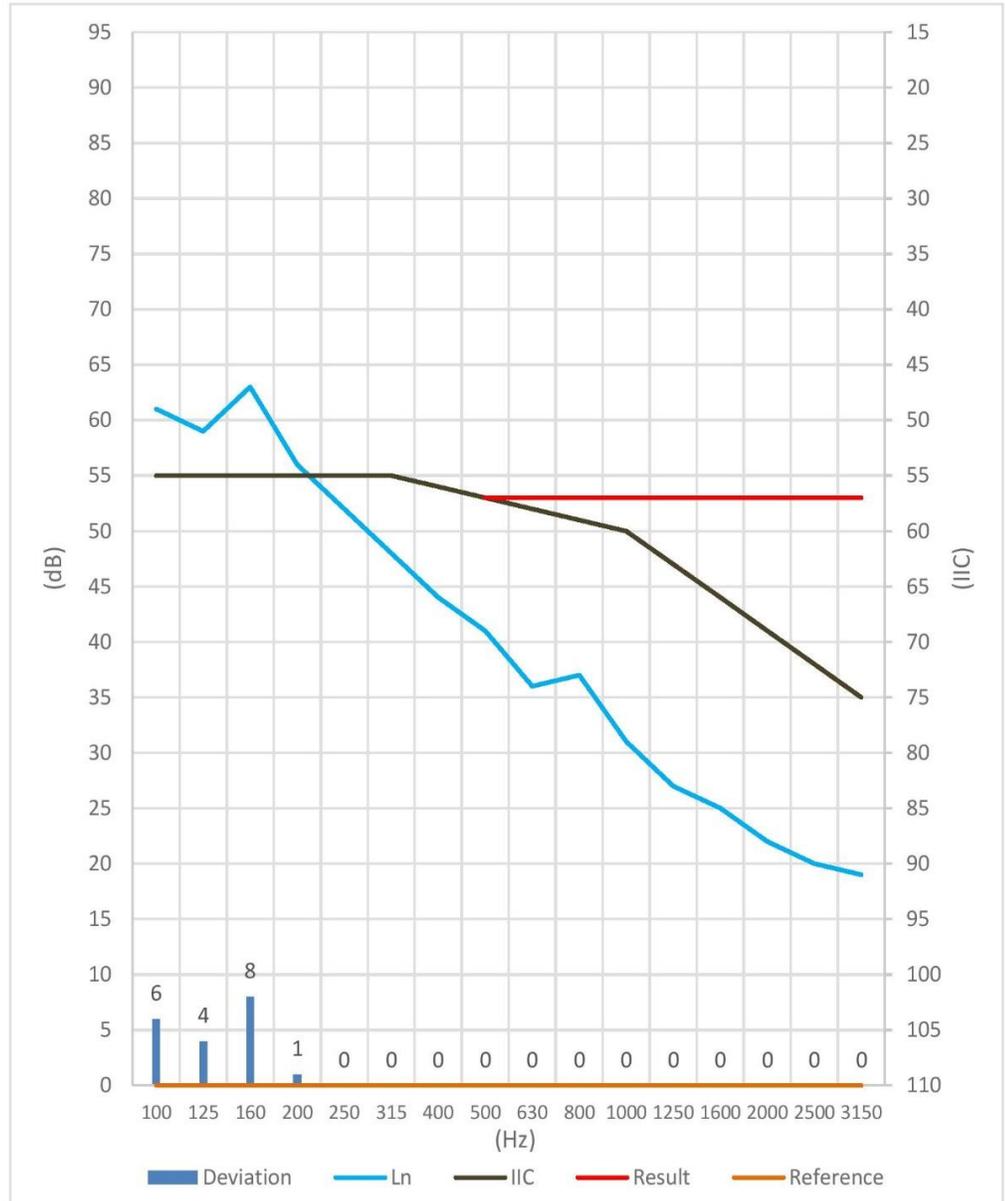

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	61	59	63	56	52	48	44	41	36	37	31	27	25	22	20	19
IIC	55	55	55	55	55	55	54	53	52	51	50	47	44	41	38	35
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	62,68	59,1	62,86	55,86	51,72	46,62	42,55	40,01	35,85	35,42	29,96	25,06	21,07	18,53	16,35	14,84
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	6	4	8	1	0	0	0	0	0	0	0	0	0	0	0	0

AcoustiTECH Ceramic

5/8" OSB


5/8" OSB

AcoustiTECH SOFIX

1 1/2" standard concrete

Soprema Insonomat

IIC 59

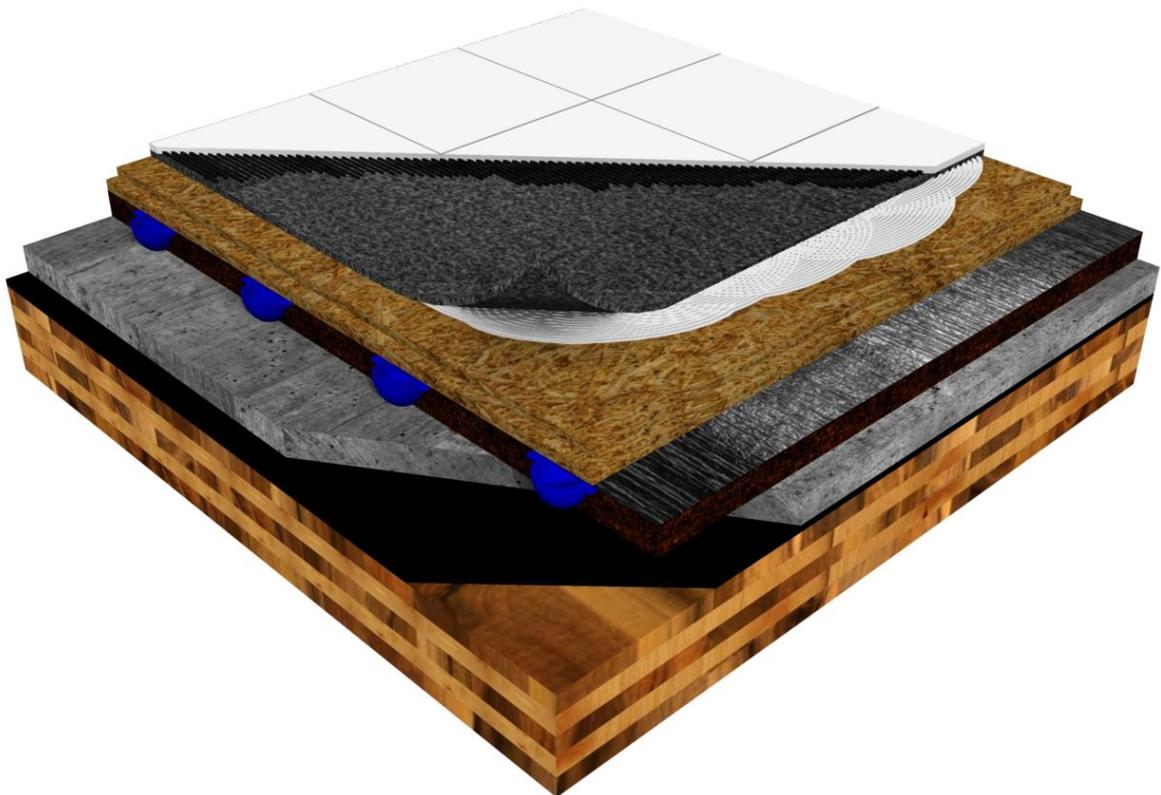

Project : Mass comparative study
Test : Test 33 - AcoustiTECH Ceramic+Ceramic

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	16,5
Receiving volume (m ³)	40


Results :

IIC	59,5
Defavorable deviations	31,5

Assembly description

OSB(0.625in)
OSB(0.625in)
AcoustiTECH SOFIX
Concrete(1.5in)
Insonomat
CLT 131mm


Thickness w/out CLT: 123mm (4.8in)

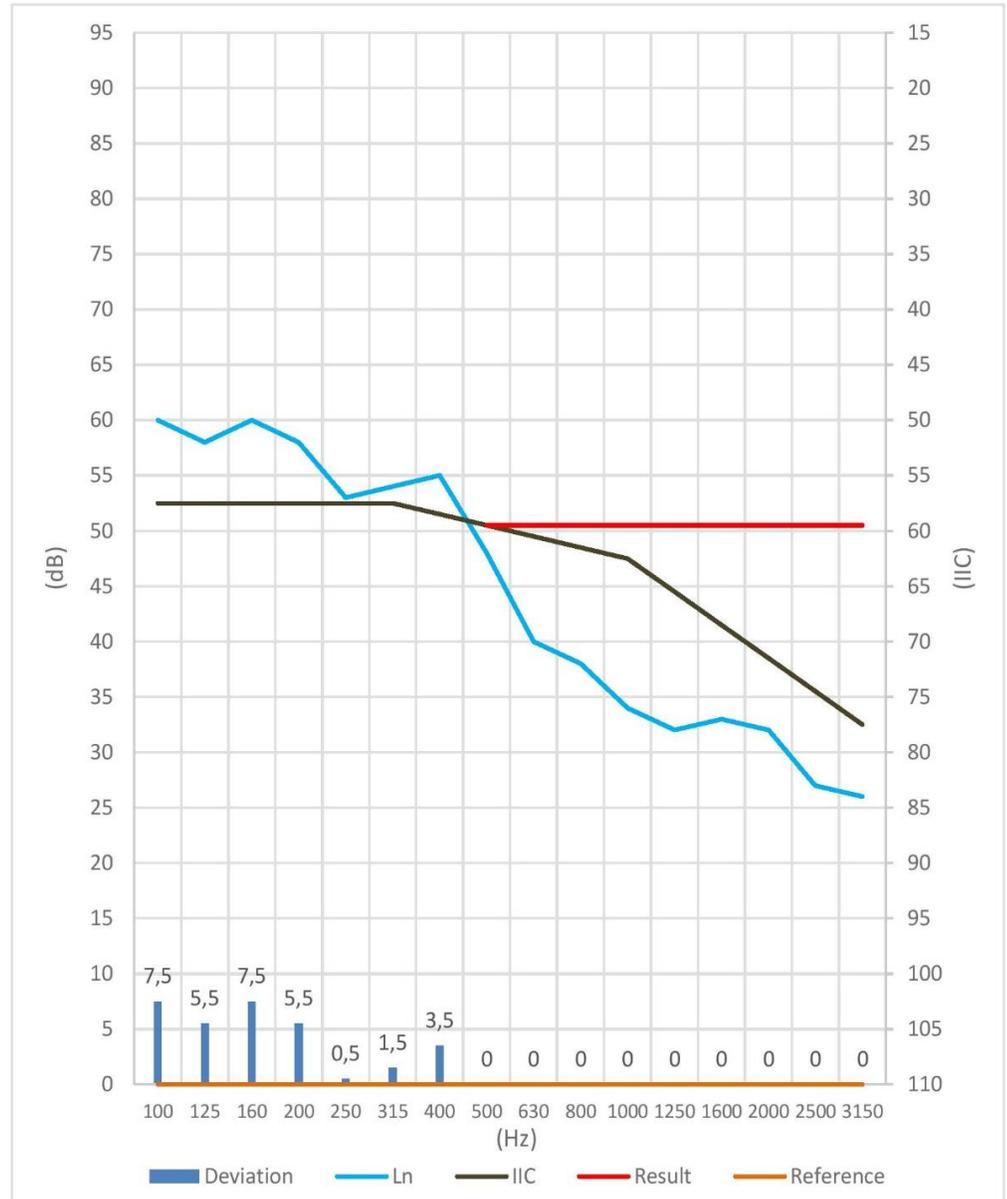

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	60	58	60	58	53	54	55	48	40	38	34	32	33	32	27	26
IIC	52,5	52,5	52,5	52,5	52,5	52,5	51,5	50,5	49,5	48,5	47,5	44,5	41,5	38,5	35,5	32,5
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	61,21	59,04	59,3	57,7	52,7	53,03	53,54	47,41	39,72	36,85	33,02	29,34	29,2	28,19	23,03	20,64
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	7,5	5,5	7,5	5,5	0,5	1,5	3,5	0	0	0	0	0	0	0	0	0

1 ½" standard concrete
Soprema Insonomat
5/8" OSB
Wood rafts w/ fiberglass
Soprema Acoustiboard Strips

IIC 56

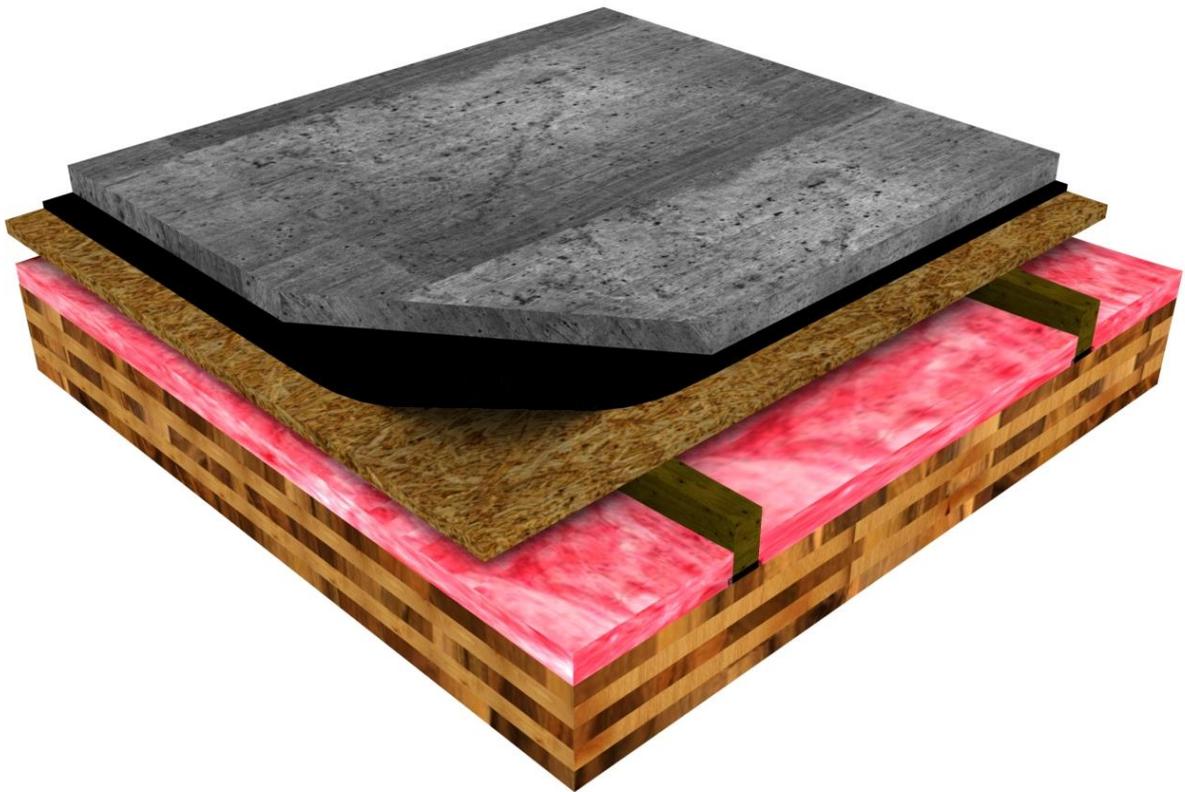

Project : Mass timber comparative study

Test : Test 2 - Bare Concrete(1.5in)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	56
Defavorable deviations	31

Assembly description

Insonomat
OSB(0.625in)
Fiberglass(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 155mm (6.1in)

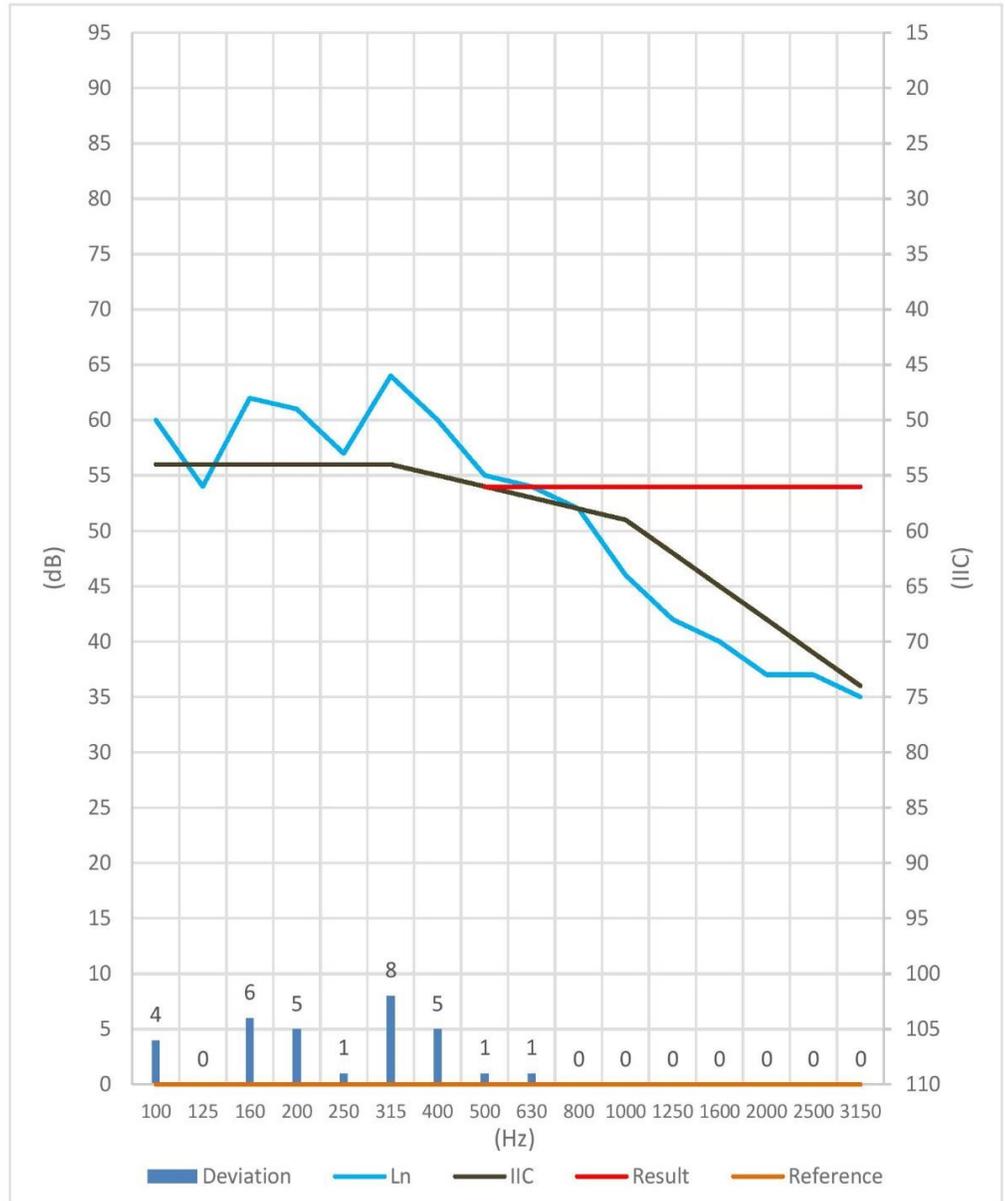

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	60	54	62	61	57	64	60	55	54	52	46	42	40	37	37	35
IIC	56	56	56	56	56	56	55	54	53	52	51	48	45	42	39	36
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	61,06	54,51	61,5	60,51	56,57	63,15	59,18	54,54	53,16	50,26	44,18	39,82	36,06	33,2	32,52	30,14
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	4	0	6	5	1	8	5	1	1	0	0	0	0	0	0	0

Soprema Insonofloor
1 ½" standard concrete
Soprema Insonomat
5/8" OSB
Wood rafts w/ fiberglass
Soprema Acoustiboard Strips

IIC 61

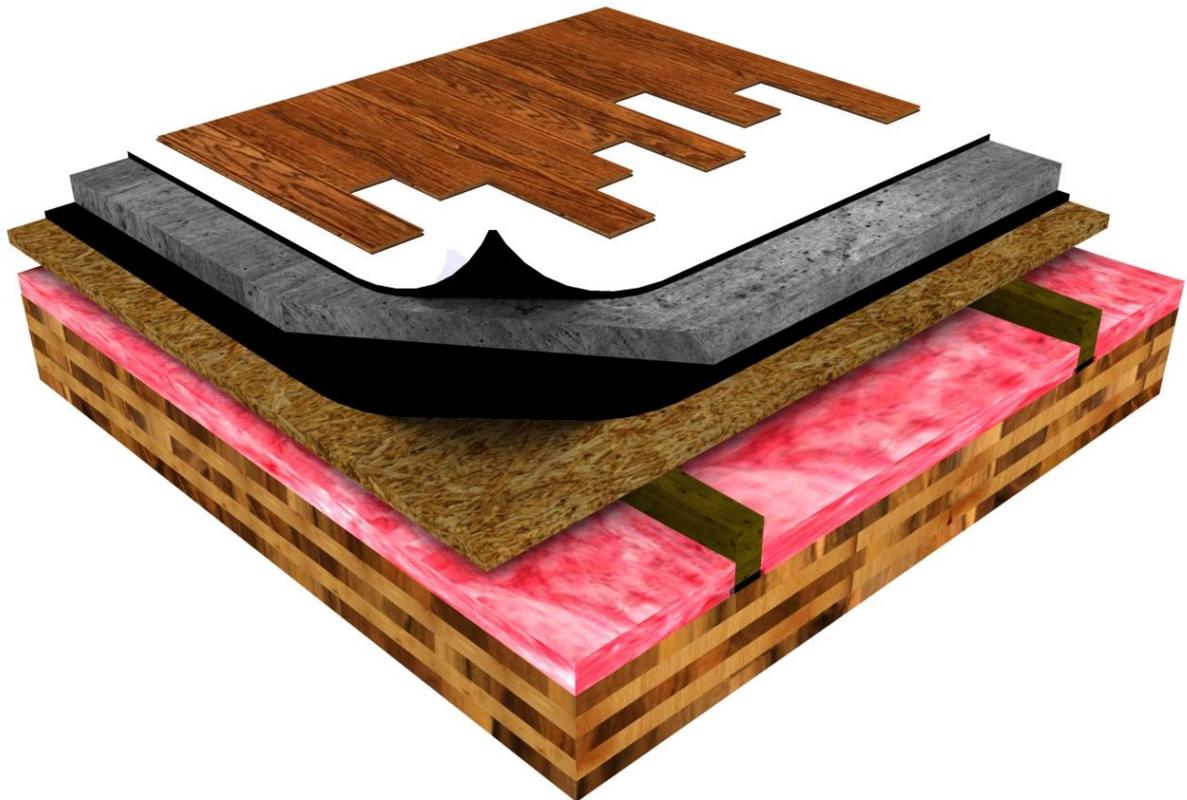

Project : Mass timber comparative study

Test : Test 3 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	61
Defavorable deviations	23

Assembly description

Insonomat
OSB(0.625in)
Fiberglass(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 155mm (6.1in)

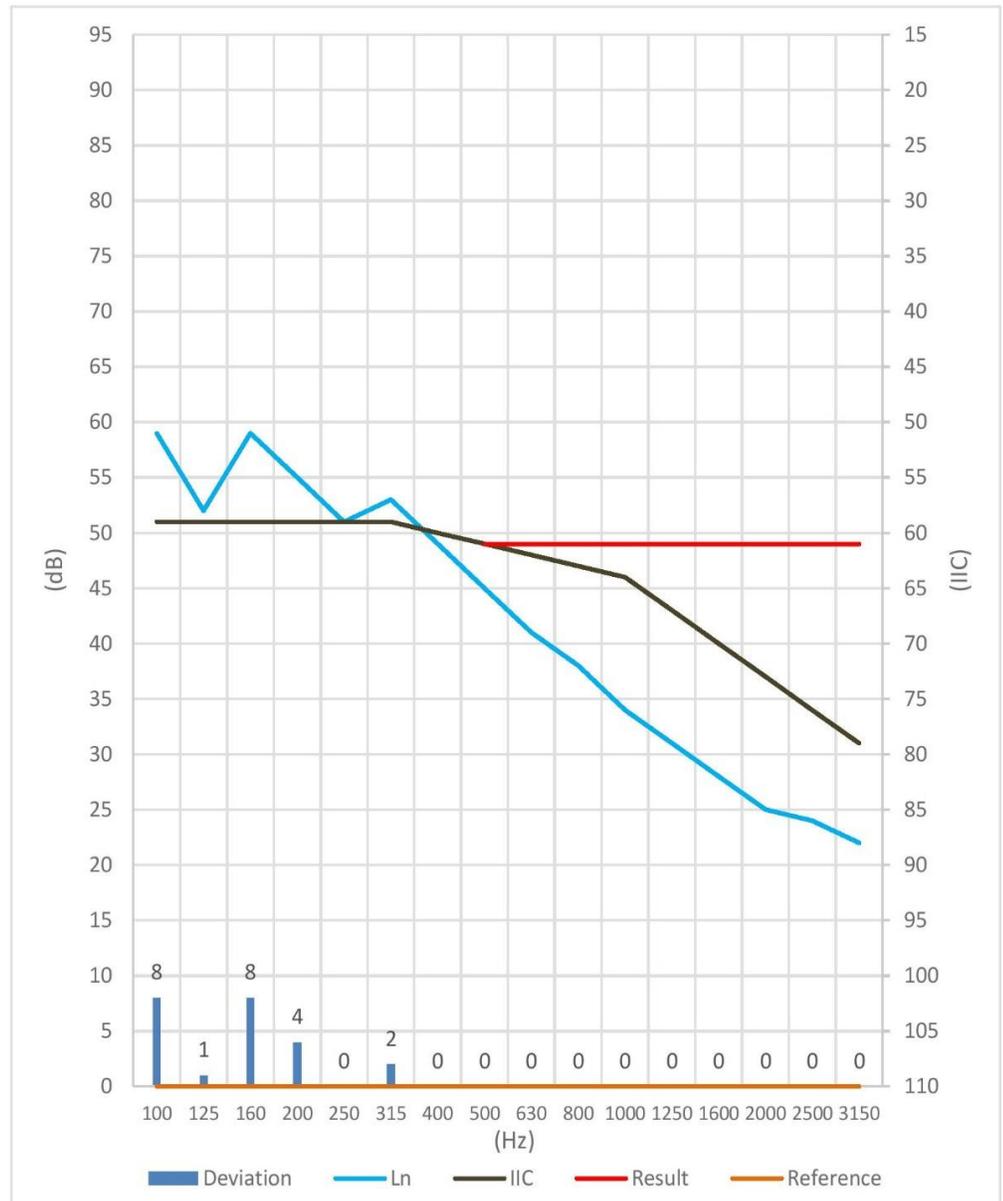

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	59	52	59	55	51	53	49	45	41	38	34	31	28	25	24	22
IIC	51	51	51	51	51	51	50	49	48	47	46	43	40	37	34	31
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	60,41	52,22	58,61	53,94	50,4	52,02	48,04	43,65	40,11	36,86	32,41	28,09	24,4	20,76	19,13	17,18
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	1	8	4	0	2	0	0	0	0	0	0	0	0	0	0

1 ½" standard concrete
Regupol SonusWave
5/8" OSB
Wood rafts w/ fiberglass
Soprema Acoustiboard Strips

IIC 57

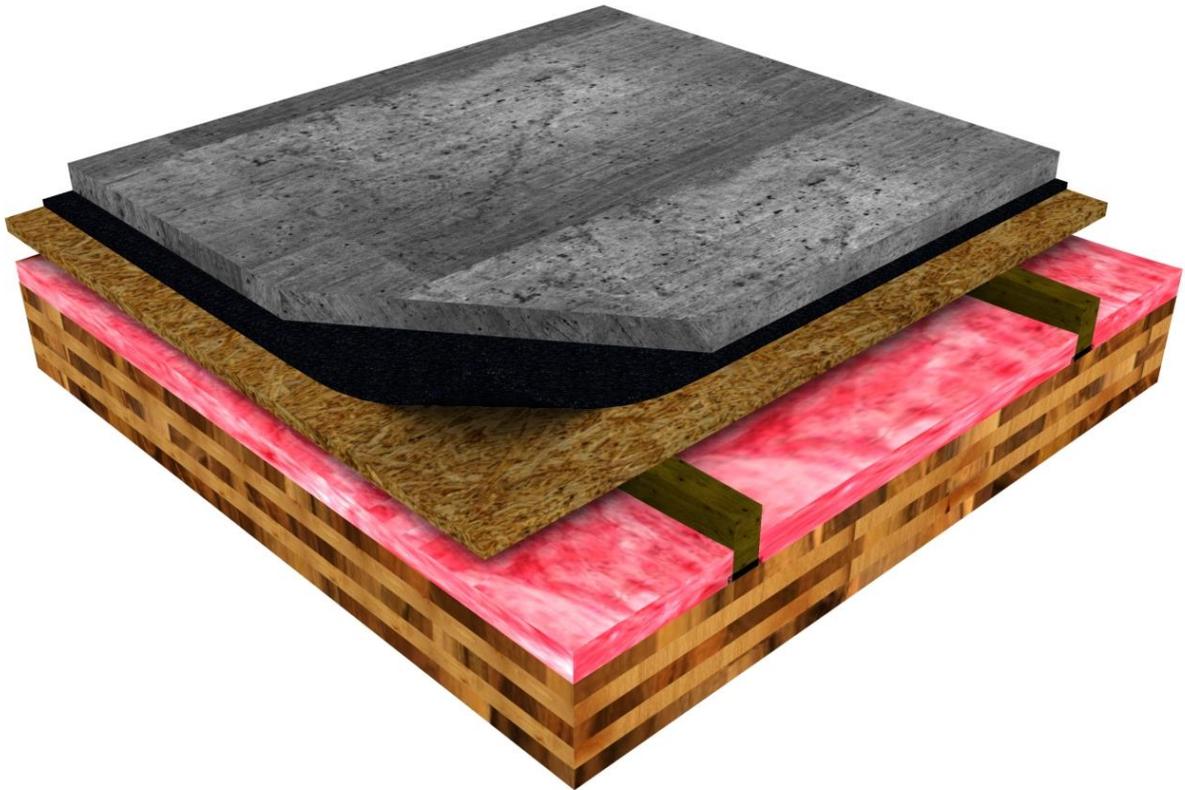

Project : Mass timber comparative study
Test : Test 4 - Bare Concrete(1.5in)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	57,4
Defavorable deviations	32

Assembly description

SonusWave(17mm)
OSB(0.625in)
Fiberglass(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 157mm (6.2in)

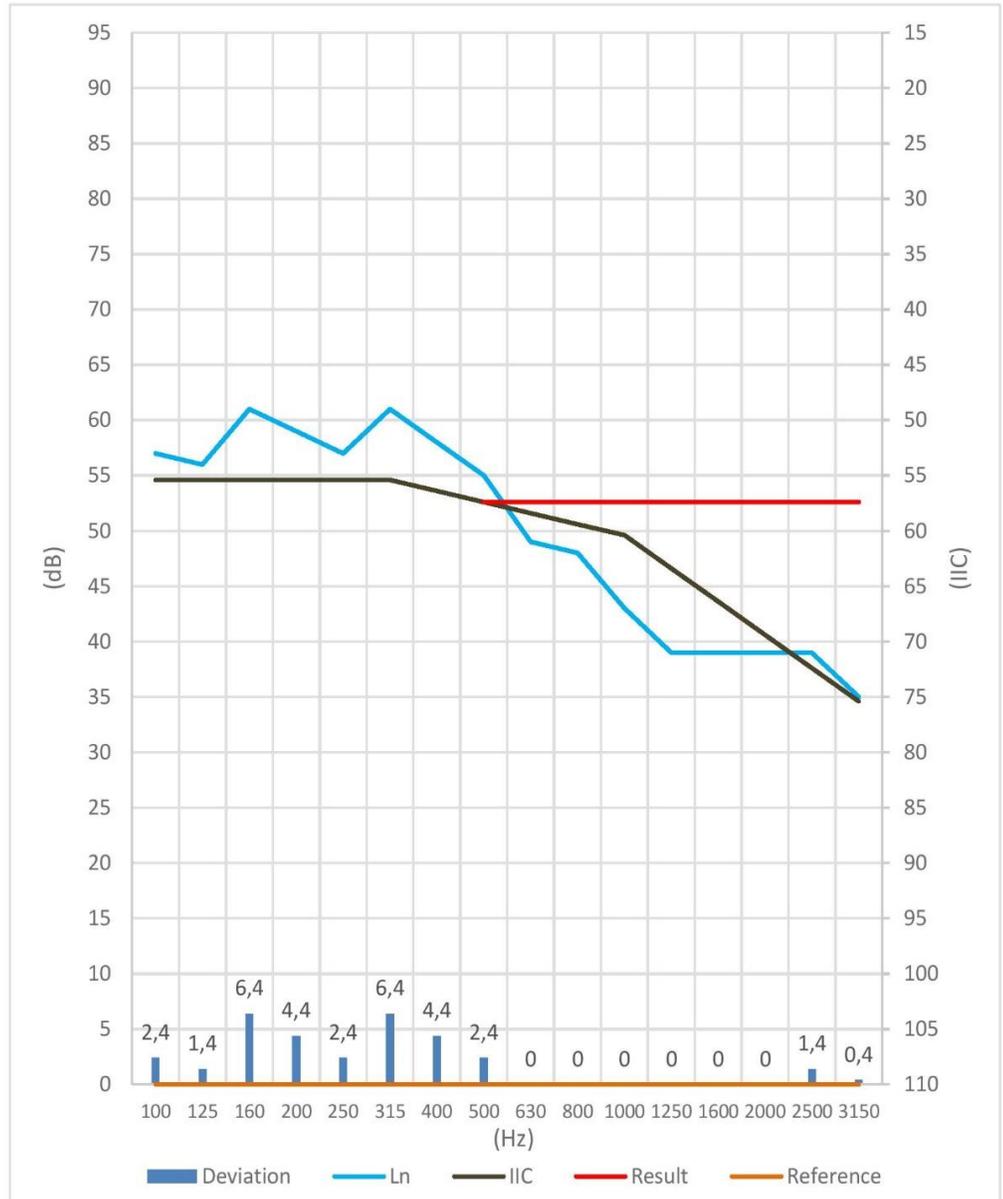

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	57	56	61	59	57	61	58	55	49	48	43	39	39	39	39	35
IIC	54,6	54,6	54,6	54,6	54,6	54,6	53,6	52,6	51,6	50,6	49,6	46,6	43,6	40,6	37,6	34,6
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	58,56	56,08	59,95	58,45	56,71	60,09	57,05	54,17	47,88	46,32	41,12	36,16	35,11	34,7	34,67	29,89
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	2,4	1,4	6,4	4,4	2,4	6,4	4,4	2,4	0	0	0	0	0	0	1,4	0,4

Soprema Insonofloor
1 ½" standard concrete
Regupol SonusWave
5/8" OSB
Wood rafts w/ fiberglass
Soprema Acoustiboard Strips

IIC 63

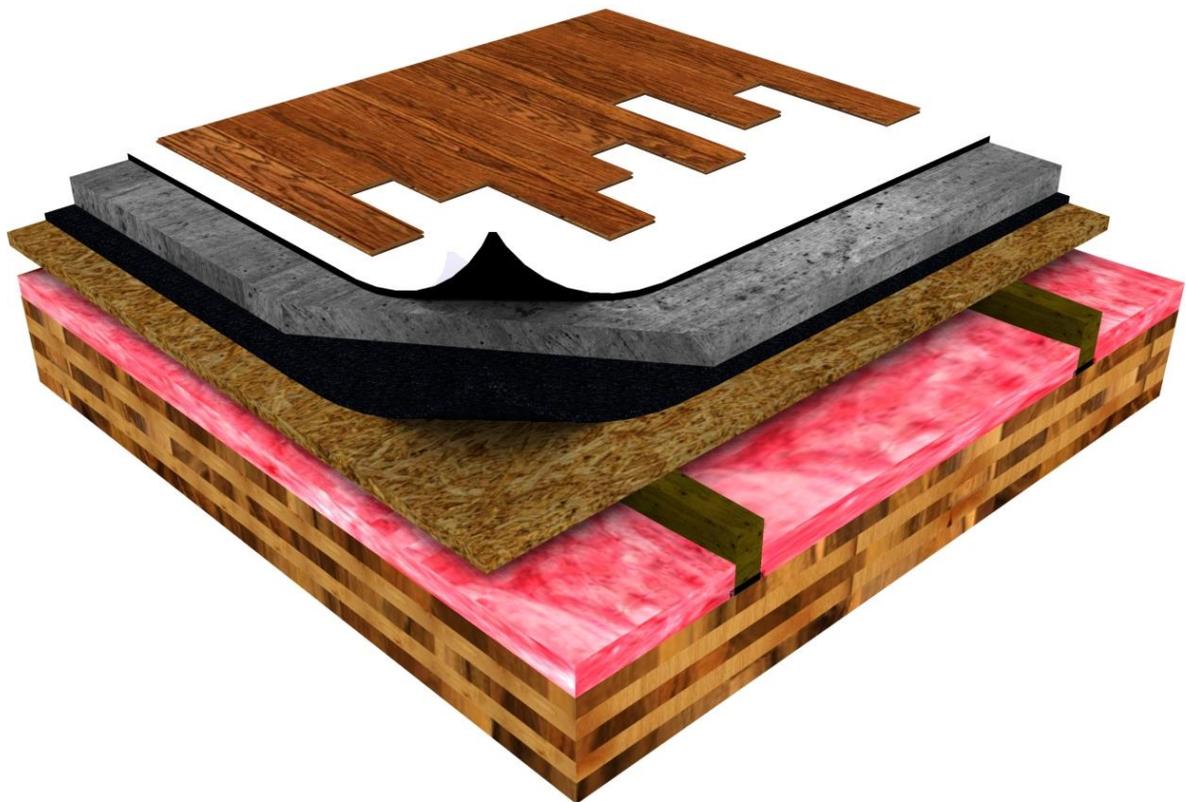

Project : Mass timber comparative study

Test : Test 5 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	63
Defavorable deviations	29

Assembly description

SonusWave(17mm)
OSB(0.625in)
Fiberglass(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 157mm (6.2in)

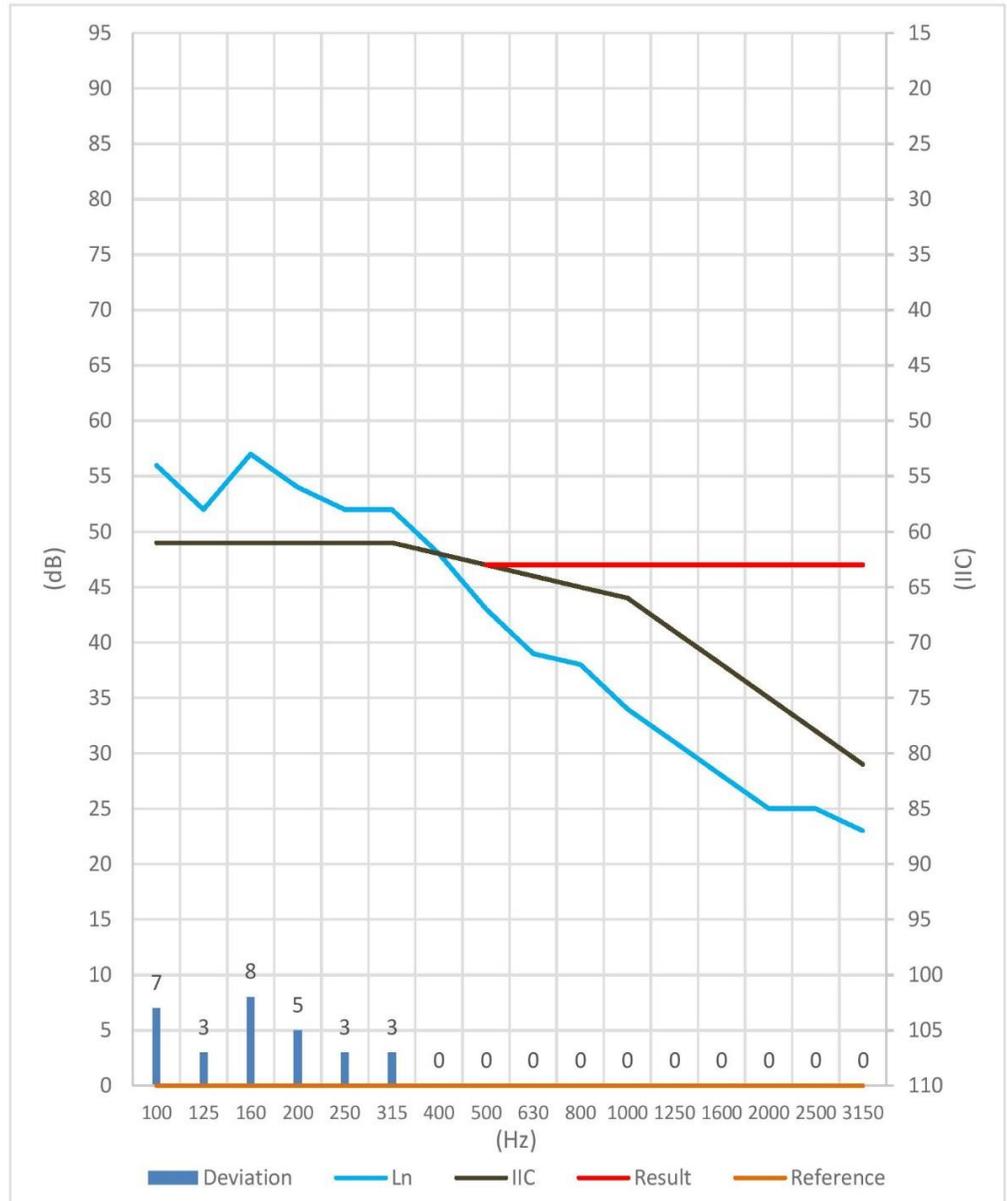

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	56	52	57	54	52	52	48	43	39	38	34	31	28	25	25	23
IIC	49	49	49	49	49	49	48	47	46	45	44	41	38	35	32	29
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	57,95	52,56	56,35	53,01	52,19	50,38	46,35	41,7	38,55	36,68	32,94	28,94	24,29	21,25	20,33	18,09
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	7	3	8	5	3	3	0	0	0	0	0	0	0	0	0	0

1 ½" standard concrete
Soprema Insonomat
5/8" OSB
Wood rafts w/ sand
Soprema Acoustiboard Strips

IIC 57

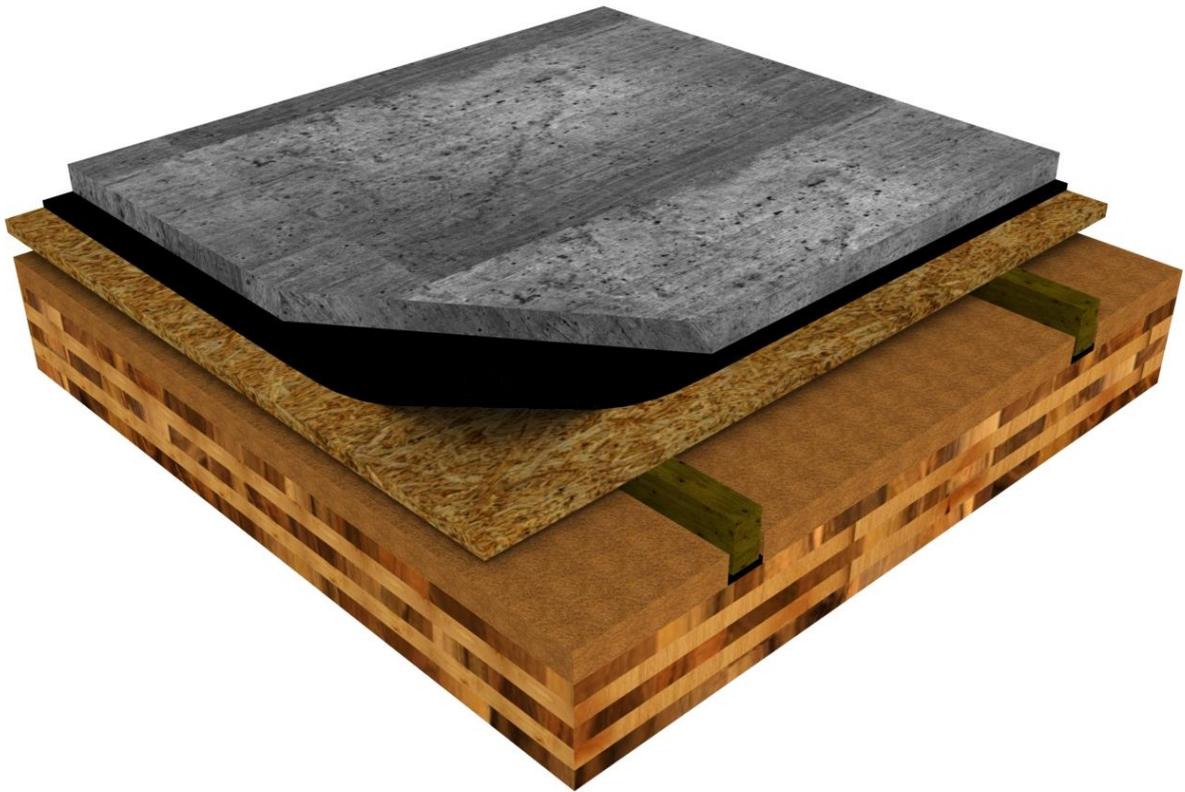

Project : Mass timber comparative study

Test : Test 6 - Bare Concrete(1.5in)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	57,1
Defavorable deviations	32

Assembly description

Insonomat
OSB(0.625in)
Sand(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 155mm (6.1in)

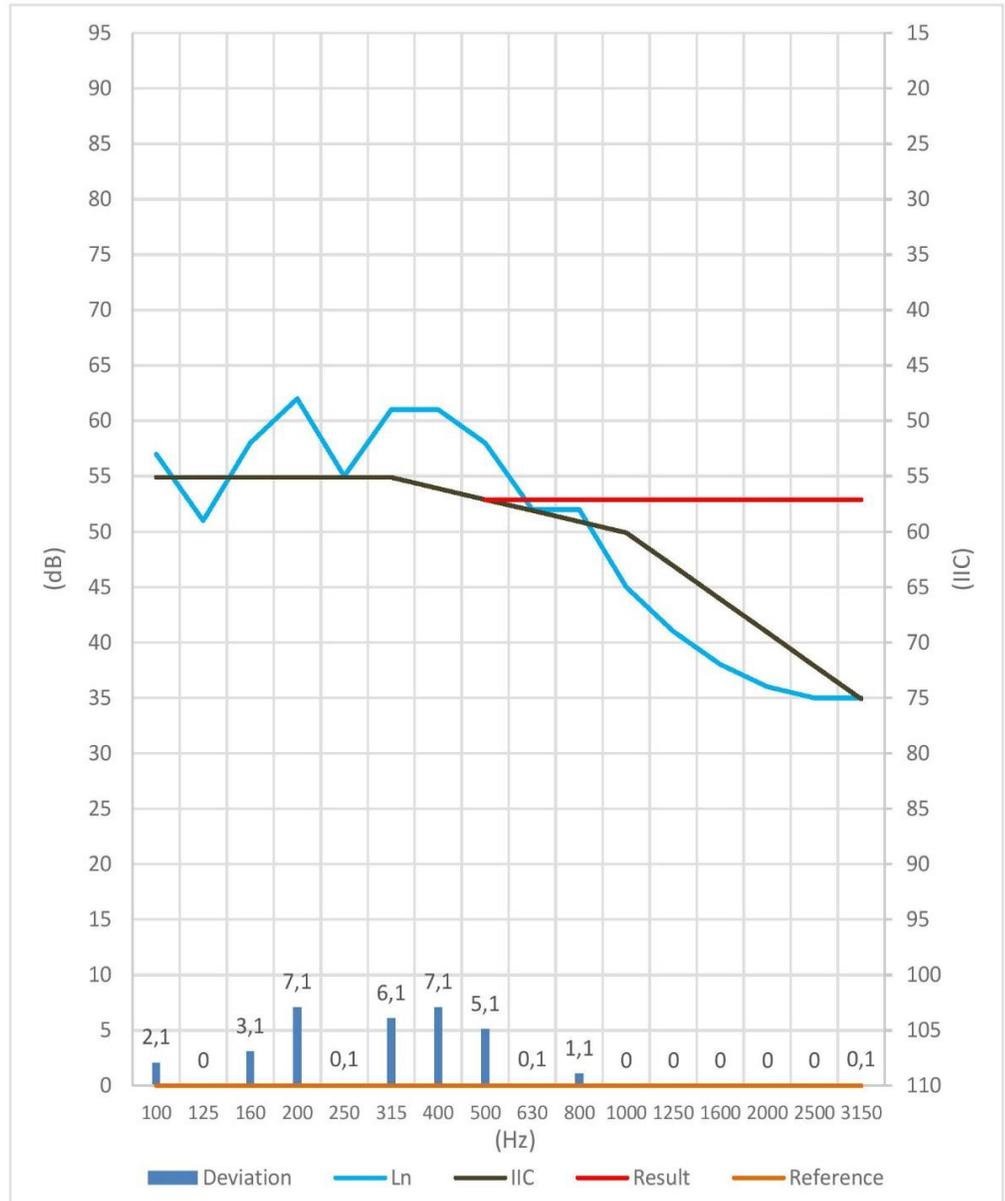

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	57	51	58	62	55	61	61	58	52	52	45	41	38	36	35	35
IIC	54,9	54,9	54,9	54,9	54,9	54,9	53,9	52,9	51,9	50,9	49,9	46,9	43,9	40,9	37,9	34,9
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	58,42	51,25	57,67	61,45	54,95	60,17	60,05	56,66	51,66	50,1	43,13	38,9	34,36	31,64	30,86	29,35
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	2,1	0	3,1	7,1	0,1	6,1	7,1	5,1	0,1	1,1	0	0	0	0	0	0,1

Soprema Insonofloor
1 ½" standard concrete
Soprema Insonomat
5/8" OSB
Wood rafts w/ sand
Soprema Acoustiboard Strips

IIC 61

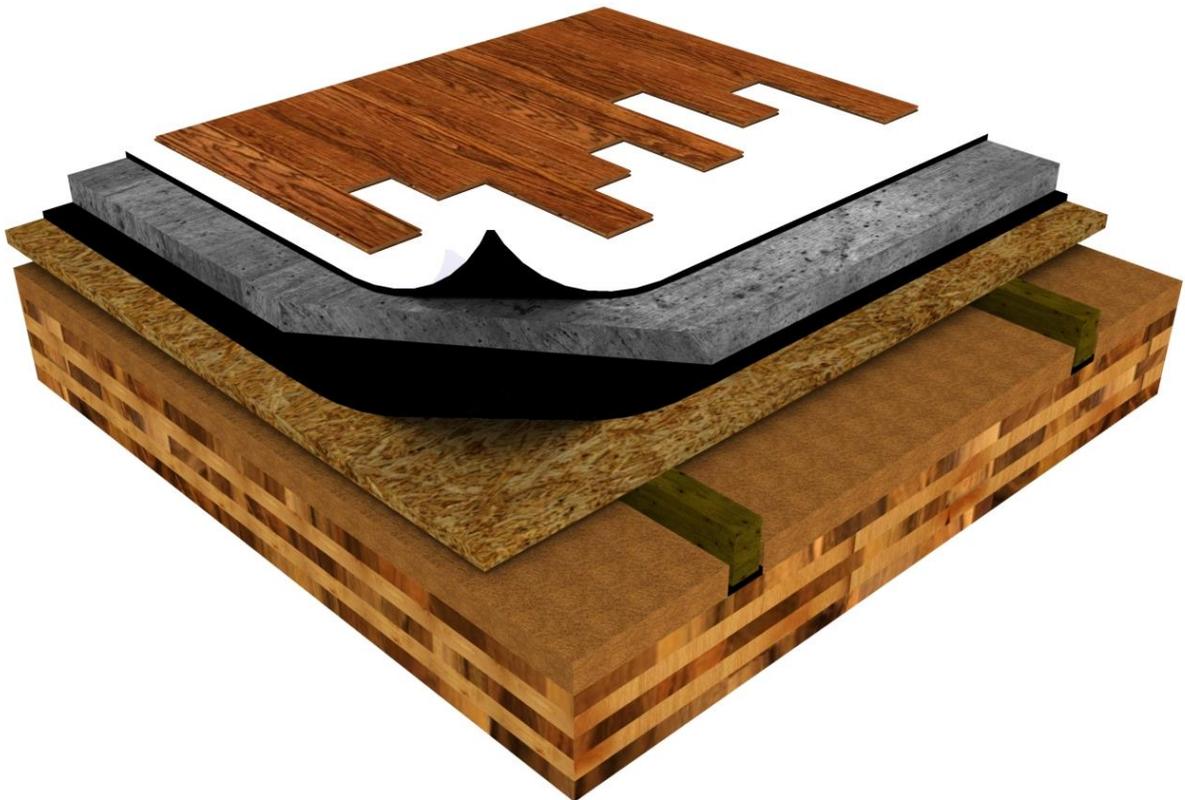

Project : Mass timber comparative study

Test : Test 7 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	61
Defavorable deviations	20

Assembly description

Insonomat
OSB(0.625in)
Sand(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 155mm (6.1in)

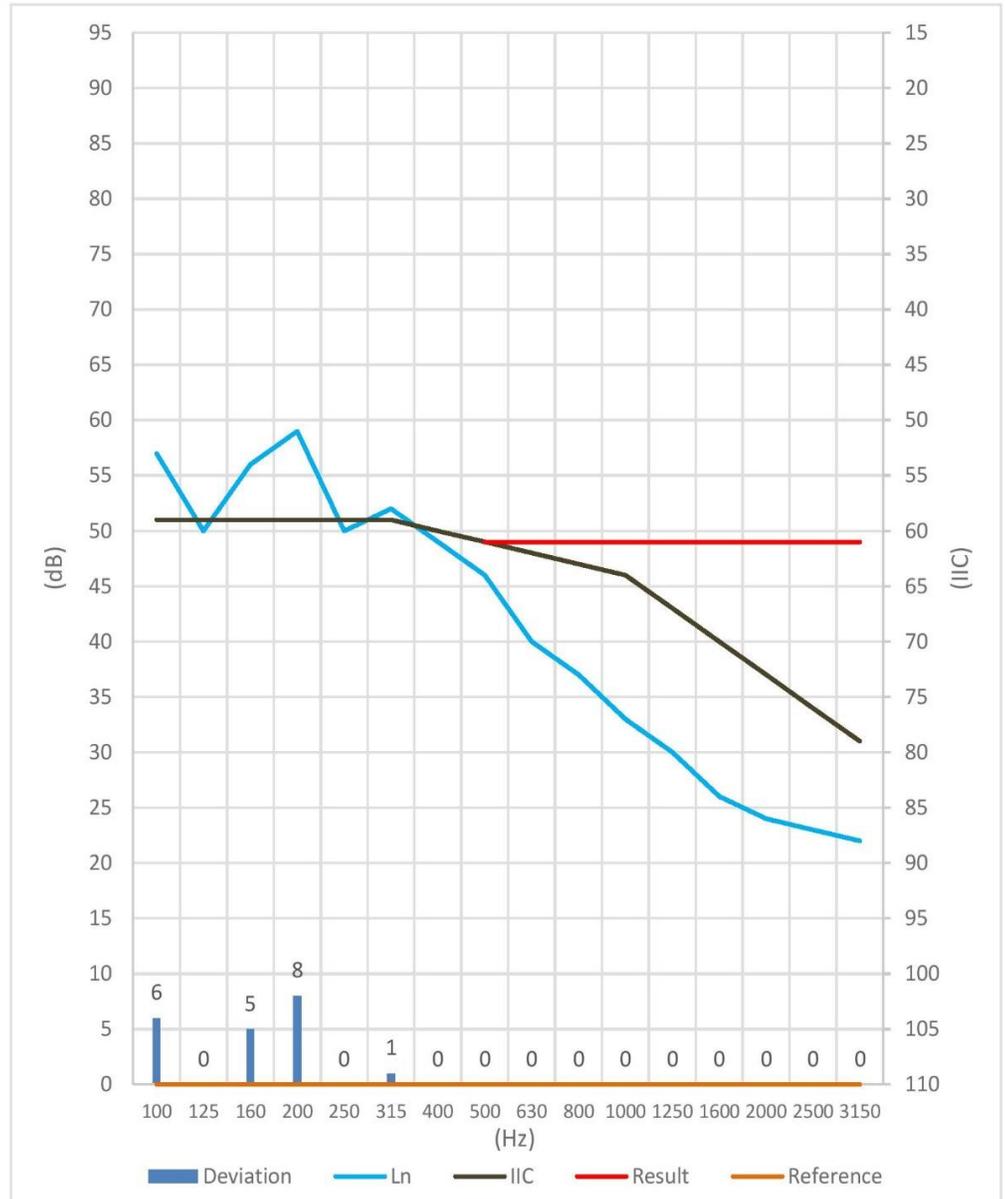

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	57	50	56	59	50	52	49	46	40	37	33	30	26	24	23	22
IIC	51	51	51	51	51	51	50	49	48	47	46	43	40	37	34	31
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	58,48	50,32	55,41	58,13	50,27	51,09	47,96	44,76	39,72	35,92	31,64	27,61	22,35	19,65	18,45	16,94
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	6	0	5	8	0	1	0	0	0	0	0	0	0	0	0	0

1 ½" standard concrete
Regupol SonusWave
5/8" OSB
Wood rafts w/ sand
Soprema Acoustiboard Strips

IIC 58

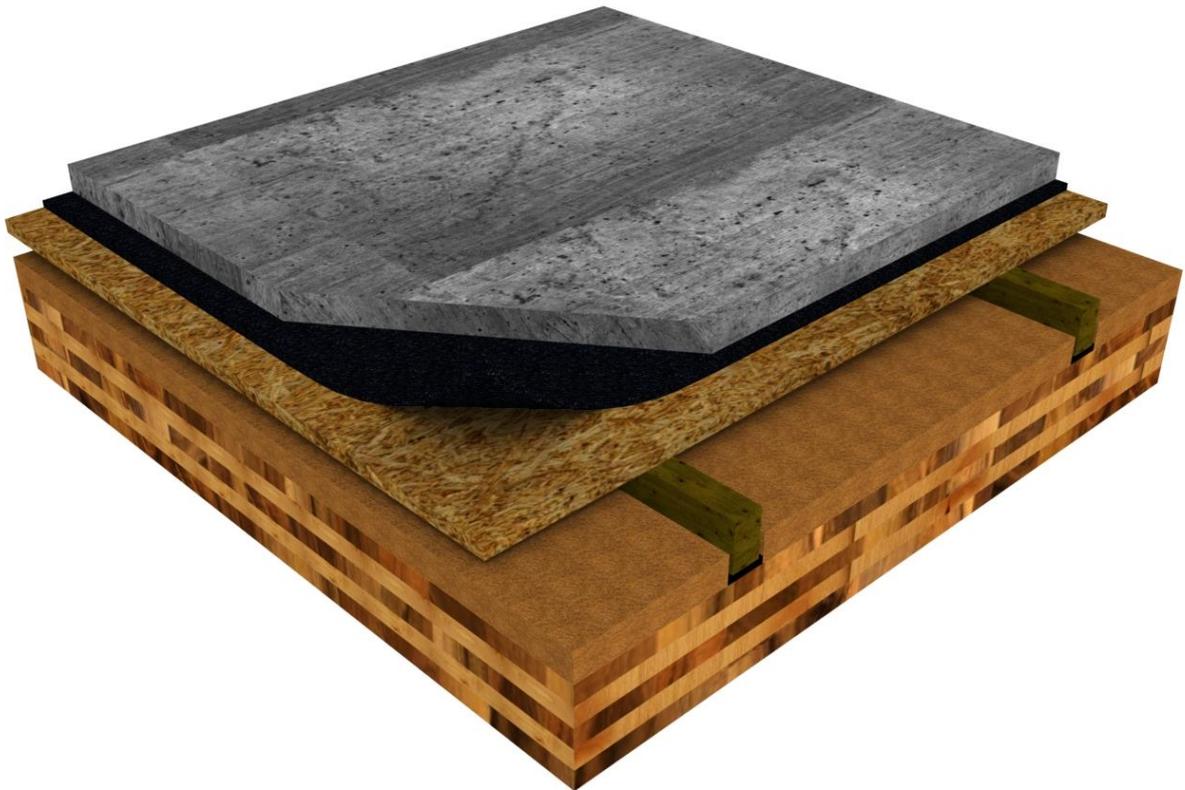

Project : Mass timber comparative study
Test : Test 8 - Bare Concrete(1.5in)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	58,8
Defavorable deviations	31,4

Assembly description

SonusWave(17mm)
OSB(0.625in)
Sand(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm


Thickness w/out CLT: 157mm (6.2in)

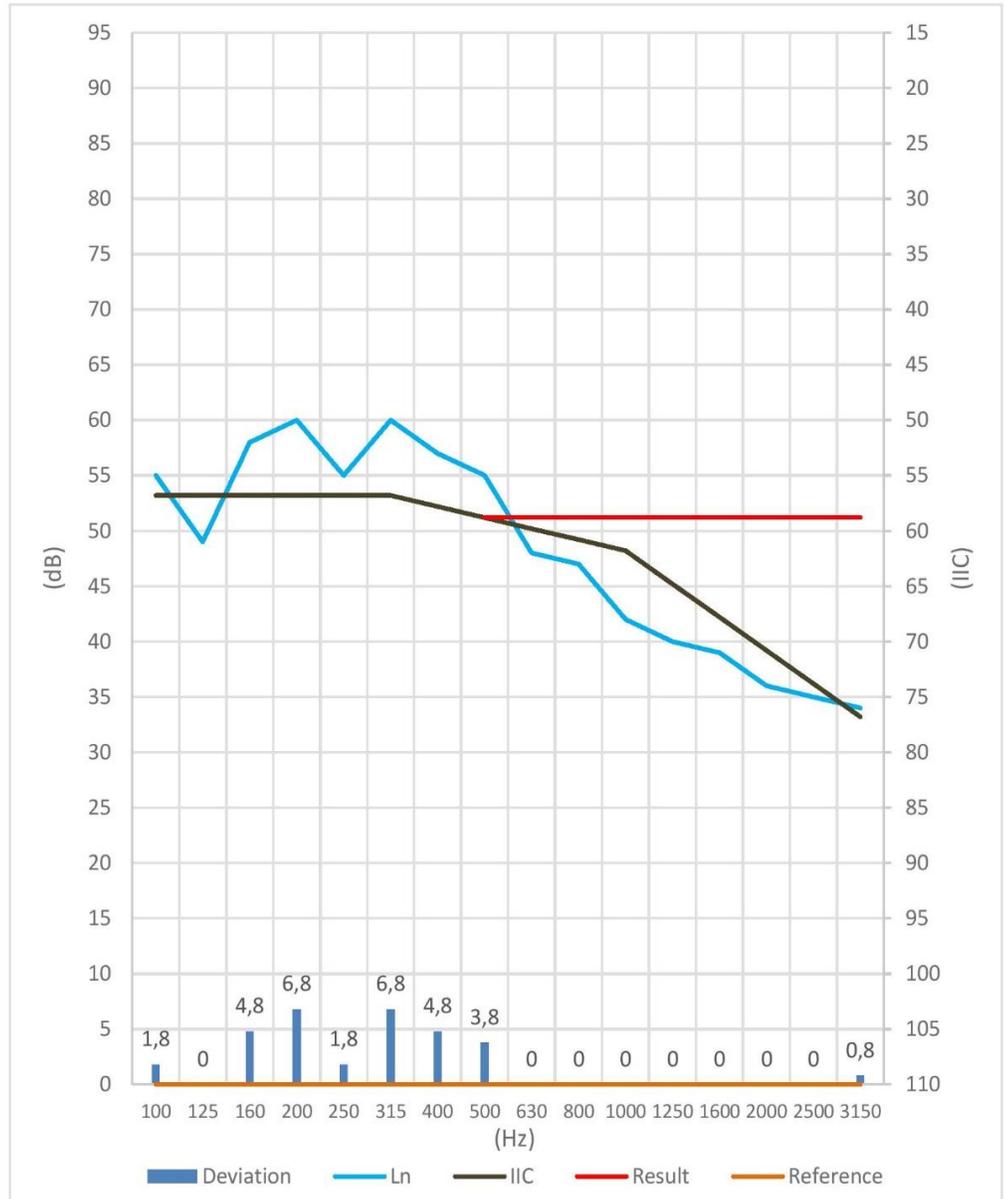

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	55	49	58	60	55	60	57	55	48	47	42	40	39	36	35	34
IIC	53,2	53,2	53,2	53,2	53,2	53,2	52,2	51,2	50,2	49,2	48,2	45,2	42,2	39,2	36,2	33,2
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	56,84	49,45	57,27	59,45	54,84	58,45	55,98	53,82	47,62	45,75	40,52	37,34	34,96	31,92	30,47	28,67
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	1,8	0	4,8	6,8	1,8	6,8	4,8	3,8	0	0	0	0	0	0	0	0,8

Soprema Insonofloor
1 ½" standard concrete
Regupol SonusWave
5/8" OSB
Wood rafts w/ sand
Soprema Acoustiboard Strips

IIC 64

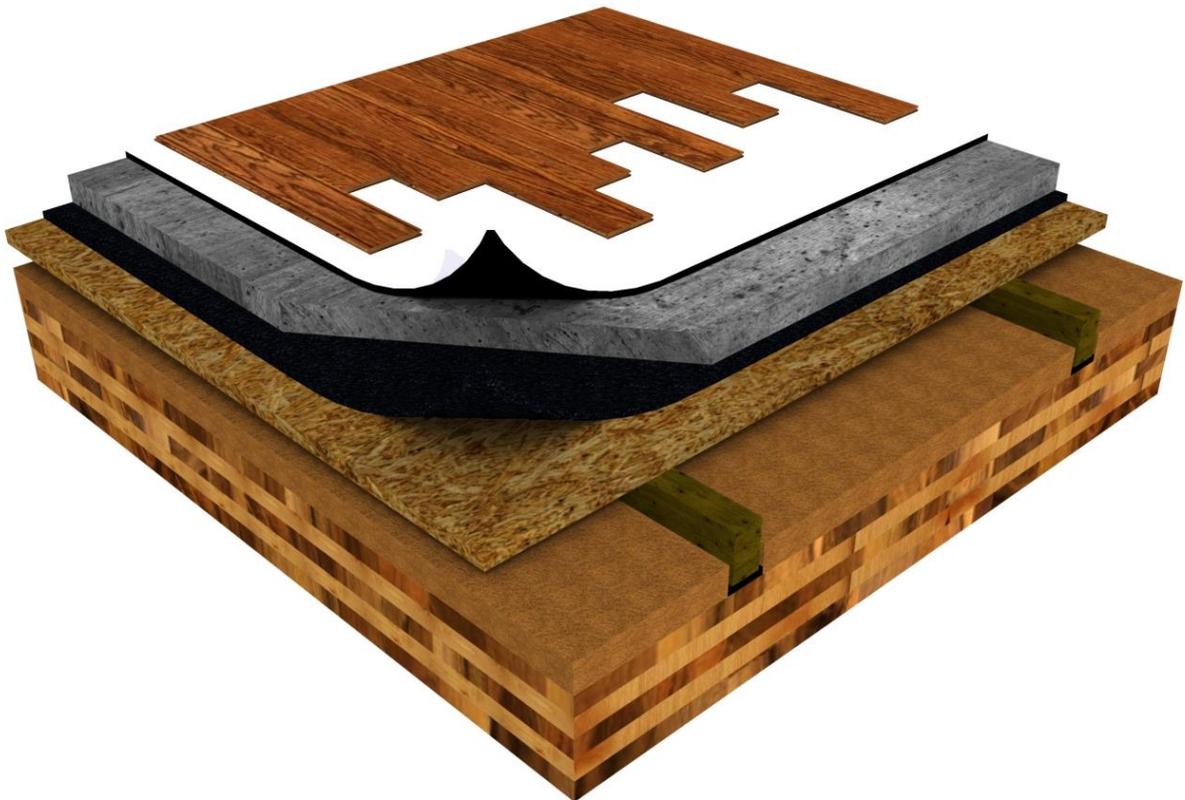

Project : Mass timber comparative study

Test : Test 9 - Concrete(1.5in)+Soprema Insonofloor+floating floor(8mm)

Description :

Emitting surface (m ²)	16,8
Emitting volume (m ³)	41
Tested surface (m ²)	2,5
Receiving surface (m ²)	14,2
Receiving volume (m ³)	41,2


Results :

IIC	64
Defavorable deviations	27

Assembly description

SonusWave(17mm)
OSB(0.625in)
Sand(1.5in)
Wood rafts (Acoustiboard strips+
2inx3in@24inO.C.)
CLT 131mm

Thickness w/out CLT: 157mm (6.2in)

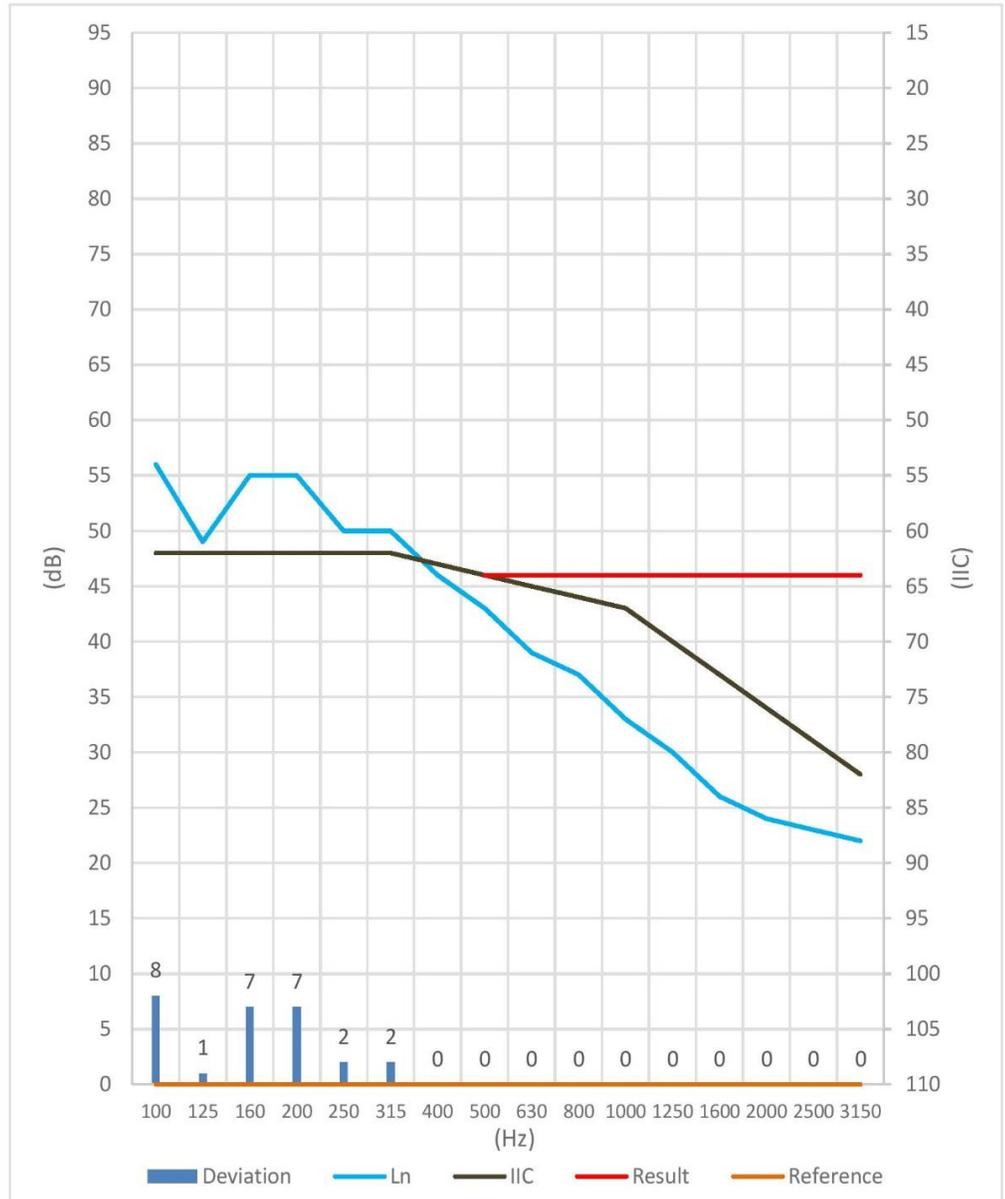

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
Ln	56	49	55	55	50	50	46	43	39	37	33	30	26	24	23	22
IIC	48	48	48	48	48	48	47	46	45	44	43	40	37	34	31	28
T20	0,94	0,68	0,62	0,6	0,64	0,55	0,53	0,45	0,5	0,42	0,44	0,31	0,25	0,25	0,22	0,2
L2	57,61	49,08	54,49	54,56	49,83	48,78	45,19	41,97	38,23	35,89	31,07	27,56	22,68	19,84	18,25	16,89
T30	0,94	0,73	0,58	0,57	0,63	0,49	0,5	0,53	0,57	0,46	0,47	0,37	0,28	0,26	0,23	0,2
B2	15,05	15,2	9,5	8,99	13,59	11,29	10,65	11,74	14,19	10,28	9,54	9,27	7,25	8,52	7,76	7,29
Deviation	8	1	7	7	2	2	0	0	0	0	0	0	0	0	0	0

AcoustiTECH

PERFORMANCE CREDIBILITY EXPERTISE

ANY QUESTIONS ?
CONTACT US !
1-888-838-4449

FOLLOW US ON SOCIAL NETWORKS

